

Sika Boom[®]-420 Fire

DECLARATION OF PERFORMANCE

No. 57696822

1	UNIQUE IDENTIFICATION CODE OF THE PRODUCT-TYPE:	57696822
2	INTENDED USE/S	ETA 19/0796/ EAD 350141-00-1106:2017 Fire Stopping, Fire Sealing & Fire Protective Products. Fire Retardant Products
3	MANUFACTURER:	Sika Services AG Tüffenwies 16-22 8064 Zürich
4	AUTHORISED REPRESENTATIVE:	
5	SYSTEM/S OF AVCP:	System 1
6b	EUROPEAN ASSESSMENT DOCUMENT:	EAD 350141-00-1106, Firestopping and Fire Sealing Products: Linear joint and gap seals, issued September 2017
	European Technical Assessment:	ETA 19/0796 of 2019/12/18
	Technical Assessment Body:	Warrington Fire Testing and Certification Limited
	Notified body/ies:	1121, 2812

Declaration of Performance

Sika Boom[®]-420 Fire
57696822
2020.01 , ver. 02
1551

7 DECLARED PERFORMANCE/S

3 Performance Of The Product And References To The Methods Used For Its Assessment

BWR	Characteristic	Assessment of characteristic
2	Safety in case of fire	
	Reaction to fire	See Clause 3.1.1
	Resistance to fire	See Clause 3.1.2
3	Hygiene, Health and the Environment	
	Dangerous substances	See Clause 3.2.1
4	Safety and Accessibility in use	
	Durability and serviceability	See Clause 3.3.1

3.1 Safety In Case Of Fire

3.1.1 Reaction To fire

System Sika Boom®-420 Fire is classified 'E' in accordance with EN 13501-1.

3.1.2 Resistance To fire

System Sika Boom®-420 Fire has been tested in accordance with EN 1366-4: 2006 + A1: 2010 based upon the test results and the field of direct application specified within EN 1366-4: 2006 + A1: 2010, the SIKA BOOM® - 420 FIRE has been classified in accordance with EN 13501-2, as given in Annex C:

The Sika Boom®-420 Fire seals may only be used in the elements of construction described in Annex C and against the substrates described in Annex C.

Provisions shall be taken such that floor joint seals cannot be stepped on e.g. by covering with wire mesh or floor finishes.

3.2 Hygiene, Health And The Environment

3.2.1 Dangerous Substances

The applicant has presented a declaration that Sika Boom®-420 Fire does not contain any substance of high concern with regards to REACH Regulations (EC) No 1907/2006 and the CLP regulation (EC) No 1272/2008 (the European GHS regulation) and are compliant with the requirements reference to <http://ec.europa.eu/enterprise/construction/cpd-ds/index.cfm>

Confirmation has further been declared that:

- Sika Boom®-420 Fire does not contain 0.1% (w/w) or more of any substance listed in the most recent Candidate List of substances of very high concern for Authorisation, published by the European Chemicals Agency ECHA on the 15.01.2019. The duty is respected to follow the development of new entries of the list and to duly inform customers, should it occur for a substance contained within the product.

Declaration of Performance

Sika Boom®-420 Fire
57696822
2020.01 , ver. 02
1551

- It does not contain 0.1% (w/w) or more of any substance listed in the most recent version of the Authorisation List (annex XIV of the REACH regulation) published by the European Chemicals Agency ECHA on the 14.05.2019.
- Its hazard classification is compliant with the requirements of the CLP regulation with all adaptations to the technical progress (ATP) up to the 13th ATP of 04.10.2018.
- For one of its components (Diisocyanate) a restriction (requiring safety measures) is part of the annex XVII of the REACH regulation. Its requirements are fully implemented.
- Its Safety Data Sheet is compliant with the requirements of the annex 2 of REACH regulation, updated by the regulation (EU) 2015/830 (of 28.05.2015). It is being applied correctly in order to fulfil the communication duties towards the customers.

All dangerous chemical substances are below the classification limits of 67/548/EEC.

In addition to the specific clauses relating to dangerous substances contained in this European Technical Assessment, there may be other requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.

3.3 Safety and Accessibility In Use

3.3.1 Durability And Serviceability

Sika Boom[®]-420 Fire has been tested in accordance with EOTA Technical Report - TR024 – Edition November 2006, for the type Y2 use category specified in EAD 350141-00-1106, and the results of the tests have demonstrated suitability for penetration seals intended for use at temperatures below 0°C, but with no exposure to rain or UV radiation.

Declaration of Performance


Sika Boom[®]-420 Fire
57696822
2020.01 , ver. 02
1551

Annex C

Resistance to Fire Classification of SIKA BOOM® - 420 FIRE


- C.1 Rigid floor constructions according to section 2 with floor thickness of minimum 200 mm
- C.1.1 Linear joint or gap seal, horizontally orientated with foam seal to the full 200 mm depth.

Construction details:

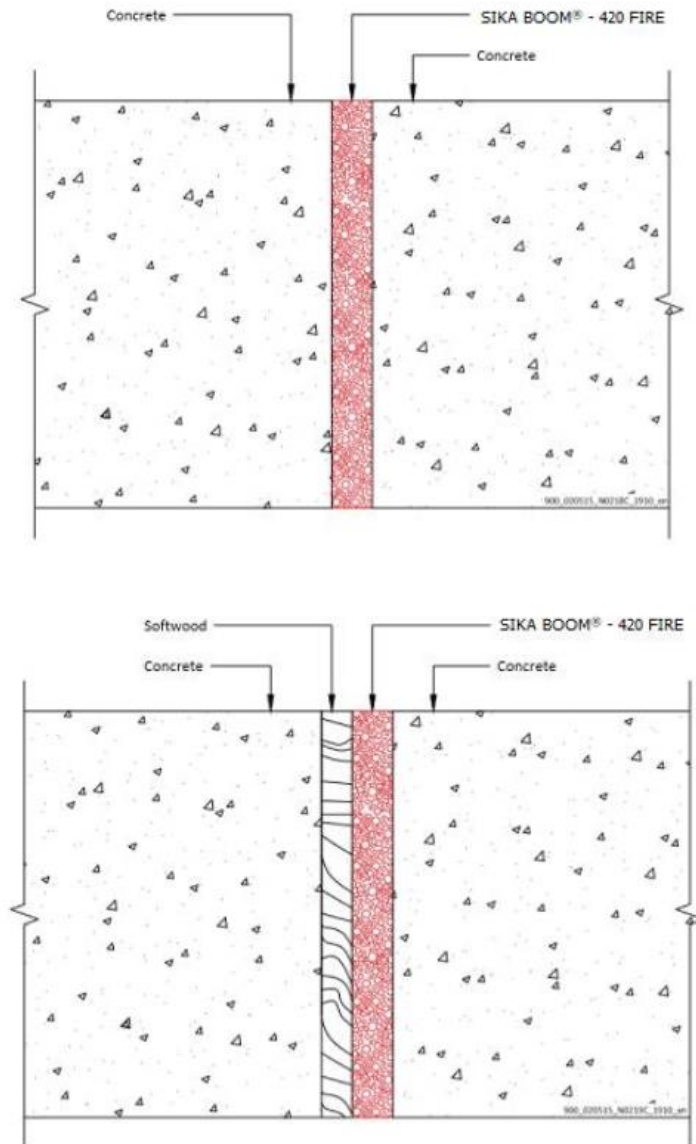

Declaration of Performance

Sika Boom®-420 Fire
57696822
2020.01 , ver. 02
1551

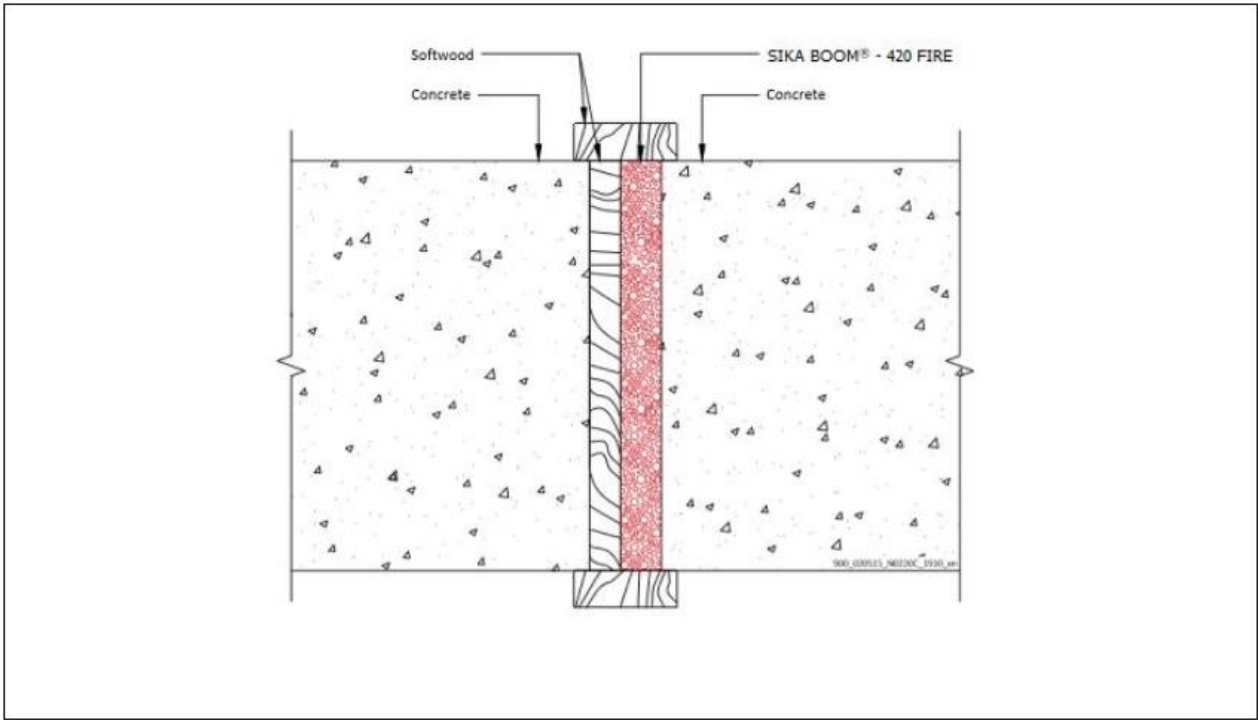

C.1.1.1

SIKA BOOM® - 420 FIRE Linear Joint Seals in 200 mm thick Rigid Floors.			
Substrates	Seal Depth	Applicator type	Classification
AAC/AAC	200 mm	Gun / Nozzle	EI 90 – H – X – F – W 0-20
		Gun / Nozzle	EI 120 – H – X – F – W 0-10
		Nozzle	EI 120 – H – X – F – W 0-20
AAC/Softwood Timber	200 mm	Gun / Nozzle	EI 120 – H – X – F – W 0-20
AAC/Softwood with 50 x 18 mm Softwood architrave on both sides	200 mm	Gun / Nozzle	EI 120 – H – X – F – W 0-20

*AAC- Aerated Concrete


Declaration of Performance

Sika Boom®-420 Fire
 57696822
 2020.01 , ver. 02
 1551

C.2 Rigid wall constructions according to section 2 with wall thickness of minimum 150 mm


C.2.1 Linear joint or gap seal, vertically or horizontally orientated (in a wall construction) with sealant to the full 150 mm depth of the wall.

Construction details:

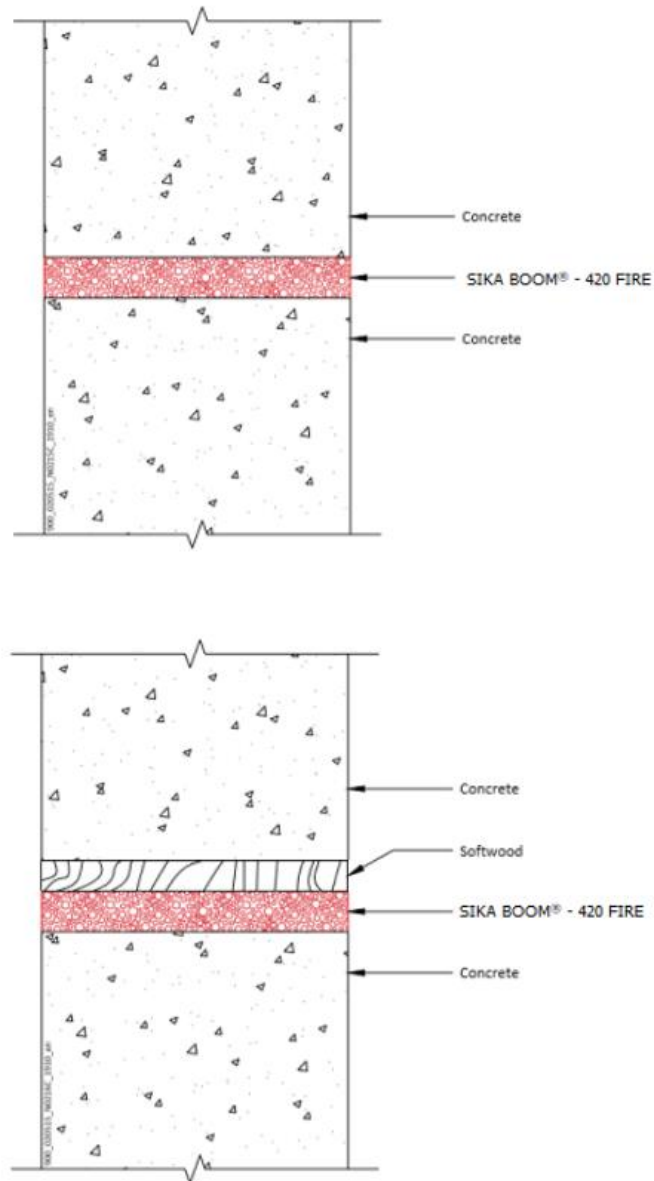

Declaration of Performance

Sika Boom®-420 Fire
57696822
2020.01 , ver. 02
1551

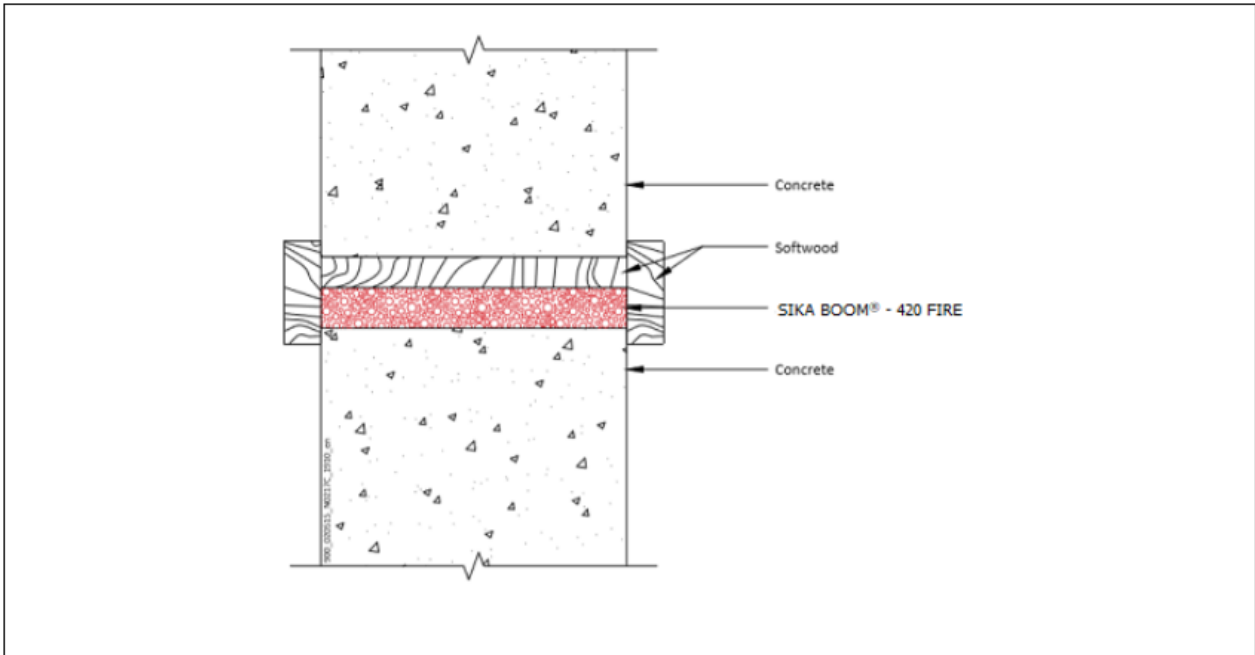

C.2.1.1

SIKA BOOM® - 420 FIRE Linear Joint Seals in 150 mm thick Rigid Walls.			
Substrates	Seal Depth	Applicator type	Classification
AAC/AAC	150 mm	Gun / Nozzle	EI 60 – V – X – F – W 0-20
		Gun / Nozzle	EI 180 – V – X – F – W 0-10
		Gun / Nozzle	EI 60 – T – X – F – W 0-20
AAC/Softwood Timber	150 mm	Gun / Nozzle	EI 120 – V – X – F – W 0-20
		Gun / Nozzle	EI 120 – T – X – F – W 0-20
AAC/Softwood with 50 x 18 mm Softwood architrave on both sides	150 mm	Gun / Nozzle	EI 90 – V – X – F – W 0-20
		Gun / Nozzle	EI 120 – T – X – F – W 0-20

*AAC- Aerated Concrete

Declaration of Performance

Sika Boom®-420 Fire
 57696822
 2020.01 , ver. 02
 1551

**8 APPROPRIATE TECHNICAL DOCUMENTATION AND/OR -
SPECIFIC TECHNICAL DOCUMENTATION**

The performance of the product identified above is in conformity with the set of declared performance/s. This declaration of performance is issued, in accordance with Regulation (EU) No 305/2011, under the sole responsibility of the manufacturer identified above.

Signed for and on behalf of the manufacturer by:

Name: Anders Beier
Function: General Manager
At Farum on 15 June 2021



.....

Name: Jens Berger
Function: Head Specialized Applicators
At Farum on 15 June 2021




.....

End of information as required by Regulation (EU) No 305/2011

Declaration of Performance

Sika Boom®-420 Fire
57696822
2020.01 , ver. 02
1551

FULL CE MARKING

 19
Sika Services AG, Zurich, Switzerland
57696822
EAD 350141-00-1106:2017
1121, 2812
Fire Stopping, Fire Sealing & Fire Protective Products. Fire Retardant Products

3 Performance Of The Product And References To The Methods Used For Its Assessment

BWR	Characteristic	Assessment of characteristic
2	Safety in case of fire	
	Reaction to fire	See Clause 3.1.1
	Resistance to fire	See Clause 3.1.2
3	Hygiene, Health and the Environment	
	Dangerous substances	See Clause 3.2.1
4	Safety and Accessibility in use	
	Durability and serviceability	See Clause 3.3.1

3.1 Safety In Case Of Fire

3.1.1 Reaction To fire

System Sika Boom®-420 Fire is classified 'E' in accordance with EN 13501-1.

3.1.2 Resistance To fire

System Sika Boom®-420 Fire has been tested in accordance with EN 1366-4: 2006 + A1: 2010 based upon the test results and the field of direct application specified within EN 1366-4: 2006 + A1: 2010, the SIKA BOOM® - 420 FIRE has been classified in accordance with EN 13501-2, as given in Annex C:

The Sika Boom®-420 Fire seals may only be used in the elements of construction described in Annex C and against the substrates described in Annex C.

Provisions shall be taken such that floor joint seals cannot be stepped on e.g. by covering with wire mesh or floor finishes.

Declaration of Performance

Sika Boom®-420 Fire
57696822
2020.01 , ver. 02
1551

3.2 Hygiene, Health And The Environment

3.2.1 Dangerous Substances

The applicant has presented a declaration that Sika Boom[®]-420 Fire does not contain any substance of high concern with regards to REACH Regulations (EC) No 1907/2006 and the CLP regulation (EC) No 1272/2008 (the European GHS regulation) and are compliant with the requirements reference to <http://ec.europa.eu/enterprise/construction/cpd-ds/index.cfm>

Confirmation has further been declared that:

- Sika Boom[®]-420 Fire does not contain 0.1% (w/w) or more of any substance listed in the most recent Candidate List of substances of very high concern for Authorisation, published by the European Chemicals Agency ECHA on the 15.01.2019. The duty is respected to follow the development of new entries of the list and to duly inform customers, should it occur for a substance contained within the product.
- It does not contain 0.1% (w/w) or more of any substance listed in the most recent version of the Authorisation List (annex XIV of the REACH regulation) published by the European Chemicals Agency ECHA on the 14.05.2019.
- Its hazard classification is compliant with the requirements of the CLP regulation with all adaptations to the technical progress (ATP) up to the 13th ATP of 04.10.2018.
- For one of its components (Diisocyanate) a restriction (requiring safety measures) is part of the annex XVII of the REACH regulation. Its requirements are fully implemented.
- Its Safety Data Sheet is compliant with the requirements of the annex 2 of REACH regulation, updated by the regulation (EU) 2015/830 (of 28.05.2015). It is being applied correctly in order to fulfil the communication duties towards the customers.

All dangerous chemical substances are below the classification limits of 67/548/EEC.

In addition to the specific clauses relating to dangerous substances contained in this European Technical Assessment, there may be other requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.

3.3 Safety and Accessibility In Use

3.3.1 Durability And Serviceability

Sika Boom[®]-420 Fire has been tested in accordance with EOTA Technical Report - TR024 – Edition November 2006, for the type Y2 use category specified in EAD 350141-00-1106, and the results of the tests have demonstrated suitability for penetration seals intended for use at temperatures below 0°C, but with no exposure to rain or UV radiation.

Declaration of Performance

Sika Boom[®]-420 Fire
57696822
2020.01 , ver. 02
1551


10/16

Annex C

Resistance to Fire Classification of SIKA BOOM® - 420 FIRE


- C.1 Rigid floor constructions according to section 2 with floor thickness of minimum 200 mm
- C.1.1 Linear joint or gap seal, horizontally orientated with foam seal to the full 200 mm depth.

Construction details:

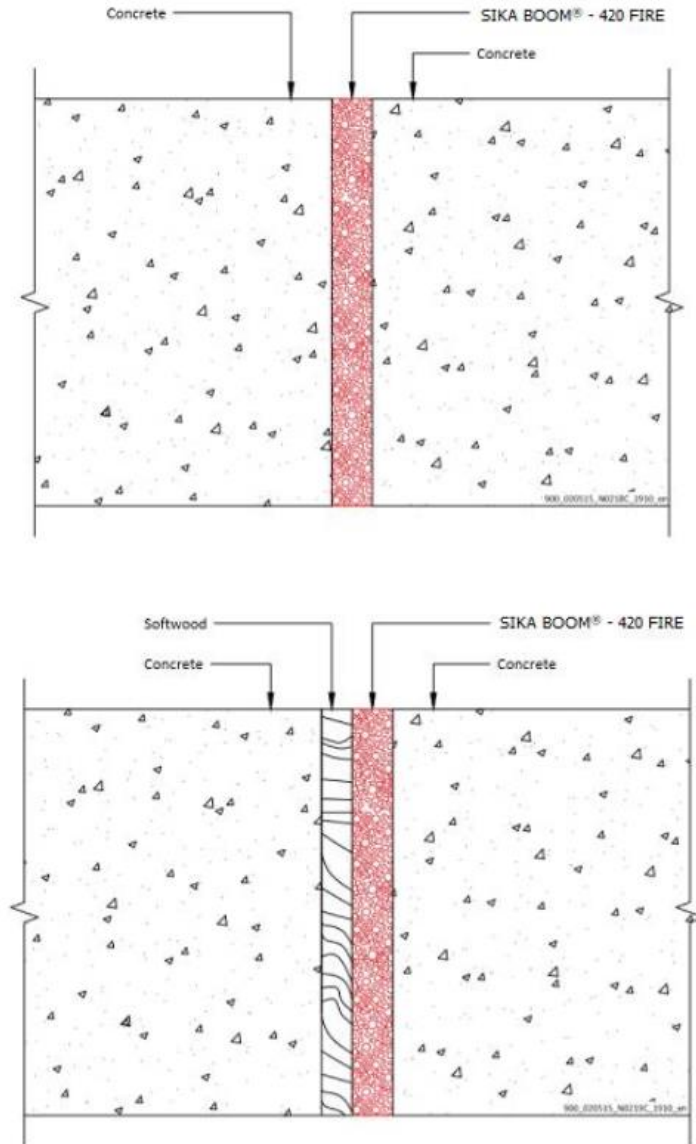

Declaration of Performance

Sika Boom®-420 Fire
57696822
2020.01 , ver. 02
1551

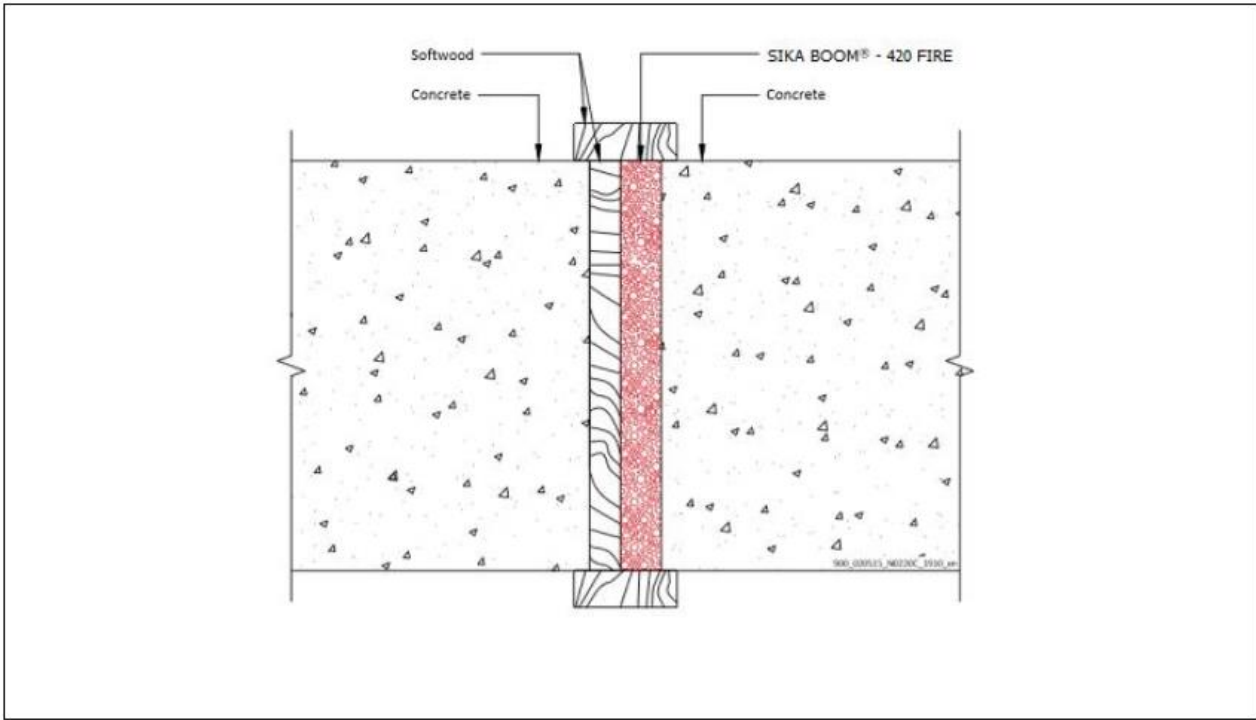

C.1.1.1

SIKA BOOM® - 420 FIRE Linear Joint Seals in 200 mm thick Rigid Floors.			
Substrates	Seal Depth	Applicator type	Classification
AAC/AAC	200 mm	Gun / Nozzle	EI 90 – H – X – F – W 0-20
		Gun / Nozzle	EI 120 – H – X – F – W 0-10
		Nozzle	EI 120 – H – X – F – W 0-20
AAC/Softwood Timber	200 mm	Gun / Nozzle	EI 120 – H – X – F – W 0-20
AAC/Softwood with 50 x 18 mm Softwood architrave on both sides	200 mm	Gun / Nozzle	EI 120 – H – X – F – W 0-20

*AAC- Aerated Concrete


Declaration of Performance

Sika Boom®-420 Fire
 57696822
 2020.01 , ver. 02
 1551

C.2 Rigid wall constructions according to section 2 with wall thickness of minimum 150 mm


C.2.1 Linear joint or gap seal, vertically or horizontally orientated (in a wall construction) with sealant to the full 150 mm depth of the wall.

Construction details:

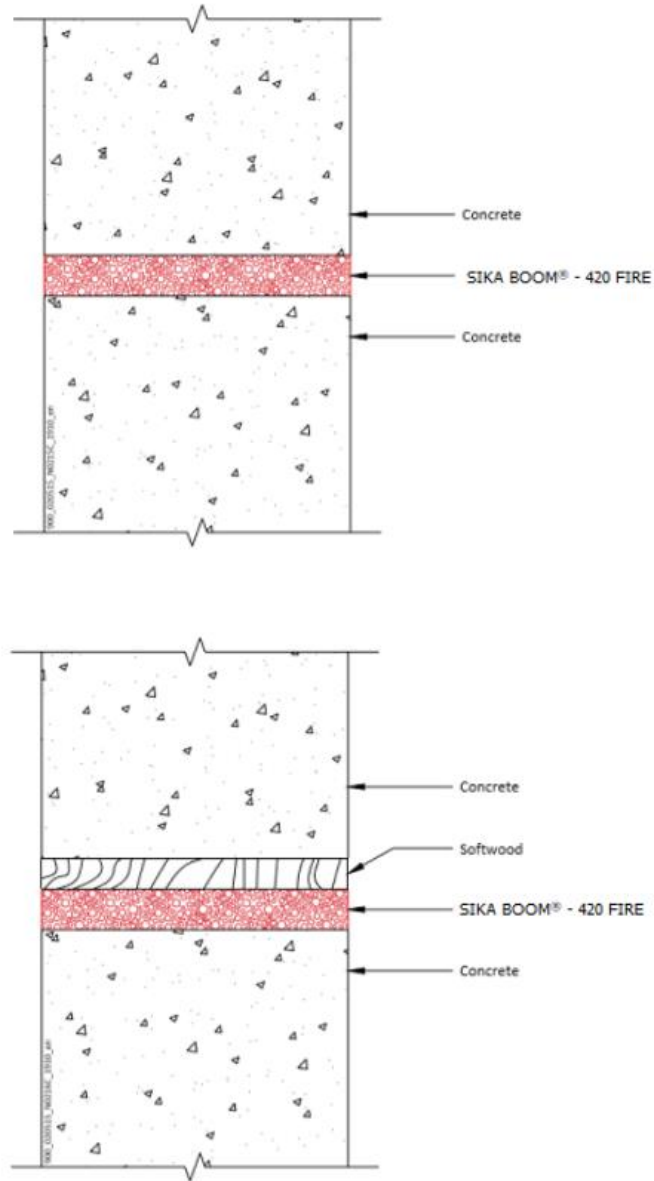

Declaration of Performance

Sika Boom®-420 Fire
57696822
2020.01 , ver. 02
1551

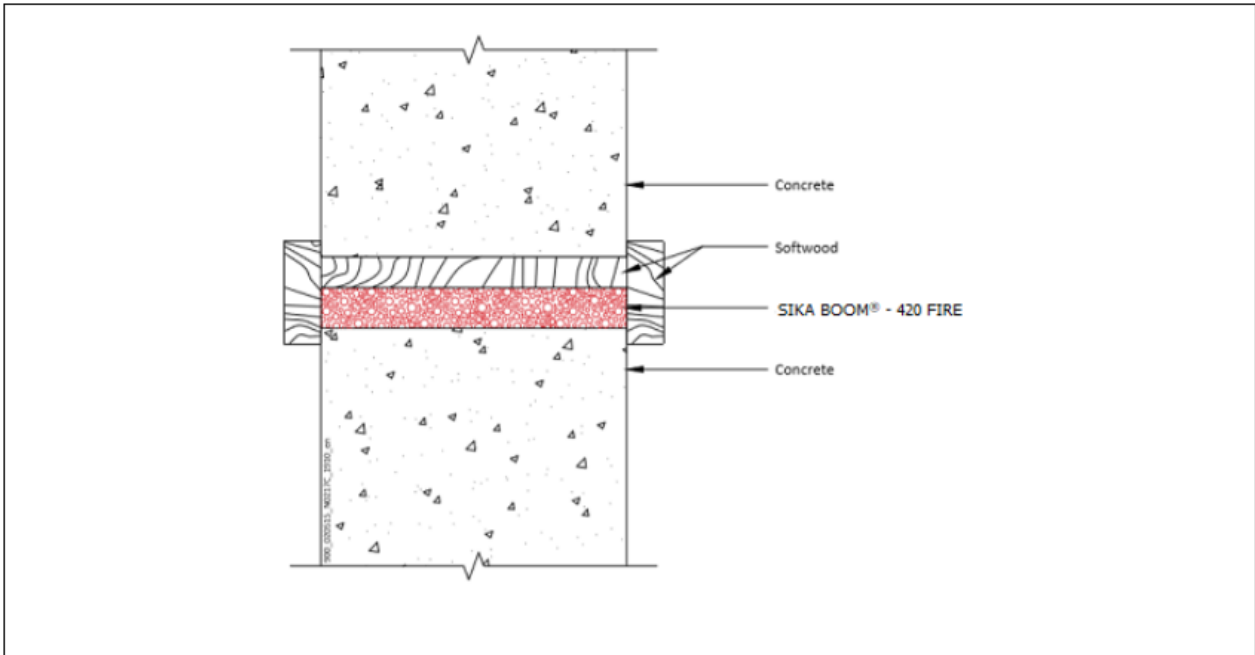

C.2.1.1

SIKA BOOM® - 420 FIRE Linear Joint Seals in 150 mm thick Rigid Walls.			
Substrates	Seal Depth	Applicator type	Classification
AAC/AAC	150 mm	Gun / Nozzle	EI 60 – V – X – F – W 0-20
		Gun / Nozzle	EI 180 – V – X – F – W 0-10
		Gun / Nozzle	EI 60 – T – X – F – W 0-20
AAC/Softwood Timber	150 mm	Gun / Nozzle	EI 120 – V – X – F – W 0-20
		Gun / Nozzle	EI 120 – T – X – F – W 0-20
AAC/Softwood with 50 x 18 mm Softwood architrave on both sides	150 mm	Gun / Nozzle	EI 90 – V – X – F – W 0-20
		Gun / Nozzle	EI 120 – T – X – F – W 0-20

*AAC- Aerated Concrete

dop.sika.com

Declaration of Performance

Sika Boom®-420 Fire
 57696822
 2020.01 , ver. 02
 1551

CE MARKING TO BE PLACED ON THE LABEL

 19
Sika Services AG, Zurich, Switzerland
57696822
EAD 350141-00-1106:2017
1121, 2812
Fire Stopping, Fire Sealing & Fire Protective Products. Fire Retardant Products
For details see accompanying documents
dop.sika.com

ECOLOGY, HEALTH AND SAFETY INFORMATION (REACH)

For information and advice on the safe handling, storage and disposal of chemical products, users shall refer to the most recent Safety Data Sheet (SDS) containing physical, ecological, toxicological and other safety related data.

LEGAL NOTE

Any information or suggestions for use concerning Sika's products, which we either in writing or orally have given buyers or end-users of the product have been given in good faith based on our own experiences and based of approved praxis and the technological and scientific knowledge on the time of giving such suggestions and information, which are given without any type of guarantees, and which do not lead to any further responsibility from Sika Danmark A/S, besides what is stated in the sales agreement in question. The buyer or end-user should themselves investigate or otherwise make sure that our products are suitable for the use in question and further make sure that the products are kept and used correct and in agreement with the published rules and considering the actual conditions in order to avoid damages or less satisfactory results. Any order is accepted and any deliverance is effected according to the general terms of sales and delivery from Sika Danmark A/S, which are considered known and accepted, and which could be handed out when asked for. Our catalogues are not up-dated automatically. The present product data sheet is only for use in Denmark. Values stated in the present product data sheet should be seen as recommended, unless stated otherwise.

Declaration of Performance

Sika Boom®-420 Fire
57696822
2020.01 , ver. 02
1551

15/16

BUILDING TRUST



Sika Danmark A/S
Hirsemarken 5
DK-3520 Farum
Denmark
www.sika.dk

Declaration of Performance

Sika Boom[®]-420 Fire
57696822
2020.01 , ver. 02
1551

16/16

BUILDING TRUST

