

ETA-Danmark A/S Göteborg Plads 1 DK-2150 Nordhavn Tel. +45 72 24 59 00 Internet www.etadanmark.dk Authorised and notified according to Article 29 of the Regulation (EU) No 305/2011 of the European Parliament and of the Council of 9 March 2011



### European Technical Assessment ETA-21/1032 of 2021/11/25

I General Part

Technical Assessment Body issuing the ETA and designated according to Article 29 of the Regulation (EU) No 305/2011: ETA-Danmark A/S

Trade name of the construction product:

SikaSeal-629 Fire Wrap+

Product family to which the above construction product belongs:

Fire Stopping and Sealing Product:

Penetration Seals

Manufacturer:

Sika Services AG Tüffenwies 16 CH-8048 Zurich

**Manufacturing plant:** 

A/003

This European Technical Assessment contains:

69 pages including 1 annex which form an integral part of the document

This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of: EAD 350454-00-1104

This version replaces:

-

#### Page 2 of 68 of European Technical Assessment ETA-21/1032 issued on 2021-11-25

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

#### Table of Contents

1	Technical description of the product
2	Specification of the intended uses of the product in accordance with the applicable European Assessment Document (Hereinafter EAD): EAD 350454-00-11045
3	Performance of the product and references to the methods used for its assessment
4	ASSESSMENT AND VERIFICATION OF CONSTANCY OF PERFORMANCE (HEREINAFTER AVCP) SYSTEM APPLIED, WITH REFERENCE TO ITS LEGAL BASE
5	Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD
A.1	Rigid wall constructions with wall thickness of minimum 150 mm
A.1.1	SikaSeal-629 Fire Wrap+ penetration seals, in 100 mm thick Sikacrete-630 Fire+ seals in rigid walls with insulated metal pipes
A.1.2	SikaSeal-629 Fire Wrap+ penetration seals, in 100 mm thick Sikacrete-630 Fire+ seals in rigid walls with plastic pipes
A.2	Rigid floor constructions with a minimum thickness 150 mm
A.2.1	SikaSeal-629 Fire Wrap+ penetration seals, in 100 mm thick Sikacrete-630 Fire+ seals in rigid floors, with insulated metal pipes
A.2.2	SikaSeal-629 Fire Wrap+ penetration seals, in 100 mm thick Sikacrete-630 Fire+ seals in rigid floors, with insulated metal pipes
A.2.3	SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in Sikacrete-630 Fire+ Seal, in rigid floors
A.2.4	SikaSeal-629 Fire Wrap+ penetration seals, in 100 mm deep Sikacrete-630 Fire+ seals in rigid floors, with plastic pipes 20
A.2.5	SikaSeal-629 Fire Wrap+ penetration seals, in 100 mm thick Sikacrete-630 Fire+ seals in rigid floors, with plastic pipes 24
A.2.6	SikaSeal-629 Fire Wrap+ penetration seals, in Sikacrete-630 Fire+ seals in rigid floors, with plastic pipes
A.2.7	SikaSeal-629 Fire Wrap+ penetration seals, in 150 mm thick Sikacrete-630 Fire+ seals in rigid floors, with plastic pipes 35
A.2.8	SikaSeal-629 Fire Wrap+ penetration seals, in 50 mm deep Sikacrete-630 Fire+ seals, backed with 50 mm stone wool, in rigid floors, with plastic pipes
A.3	Flexible and rigid wall constructions with a minimum thickness 100 mm
A.3.1	SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in seals comprising 25 mm deep Sikacrete-630 Fire+ to both faces backed with 50 mm mineral fibre board, installed within flexible or rigid wall
A.3.2	SikaSeal-629 Fire Wrap+ penetration seal for composite pipes, in seals comprising 25 mm deep Sikacrete-630 Fire+ to both faces backed with 50 mm mineral fibre board, installed within flexible or rigid wall
A.3.3	SikaSeal-629 Fire Wrap+ penetration seal for insulated metal & composite pipes, in seals comprising 25 mm deep Sikacrete-630 Fire+ to both faces backed with 50 mm mineral fibre board, installed within flexible or rigid wall
A.3.4	SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in seals comprising 50 mm deep Sikacrete-630 Fire+ to both faces, installed within flexible or rigid wall
A.4	Rigid wall constructions with floor thickness of minimum 150 mm
A.4.1	SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in 1x SikaSeal-626 Fire Board+ 2-S seals, in rigid walls 46
A.4.2	SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in 2x SikaSeal-626 Fire Board+ 2-S seals, in rigid walls 47
A.5	Rigid floor constructions with floor thickness of minimum 150 mm
A.5.1	SikaSeal-629 Fire Wrap+ penetration seal for plastic pipes, in 1x SikaSeal-626 Fire Board+ 2-S, in rigid floors
A.5.2	SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in 1x SikaSeal-626 Fire Board+ 2-S, in rigid floors 50
A.5.3	SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes in 2x SikaSeal-626 Fire Board+ 2-S (separated), in rigid floors
A.5.4	SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in 2x SikaSeal-626 Fire Board+ 2-S (back to back), in rigid floors
A.6	Flexible wall constructions according to 2. 1)
A.6.1	SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in 2x SikaSeal-626 Fire Board+ 1-S in flexible or rigid walls
A.6.2	SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in 2x SikaSeal-626 Fire Board+ 1-S, in flexible or rigid walls.
A.6.3	SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in 2x SikaSeal-626 Fire Board+ 1-S, in flexible or rigid walls.
A.6.4	SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in 2x SikaSeal-626 Fire Board+ 1-S, in flexible or rigid walls.

### Page 4 of 68 of European Technical Assessment ETA-21/1032 issued on 2021-11-25

A.6.5	SikaSeal-629 Fire Wrap+ penetration seal for plastic pipes, in 2x SikaSeal-626 Fire Board+ 1-S, in flexible or rigid walls 6	50
A.6.6	Penetration seal in Sikacrete-630 Fire+ seals, in flexible* and rigid walls minimum 100 mm thick	57

#### SPECIFIC PARTS OF THE EUROPEAN TECHNICAL ASSESSMENT

#### 1 Technical description of the product

- 1) SikaSeal-629 Fire Wrap+ is a pipe closure device used to form penetration seals where combustible pipes and insulated metal pipes penetrate walls and floors.
- 2) The SikaSeal-629 Fire Wrap+ is supplied in Polyethylene bags size according to pipe diameter or supplied in single layer 25 metre rolls. The number of layers necessary are stated in Appendix 1. The wrap is wrapped around the pipe and pushed into the aperture in the separating element/ SikaSeal-626 Fire Board+ or cast in with Sikacrete-630 Fire+
- 3) The applicant has submitted a written declaration that the product and/or constituents of the product contains no substances which have been classified as dangerous according to Directive 67/548/EEC and Regulation (EC) No. 1272/2008 and listed in the 'indicative list on dangerous substances' of the EGDS taking into account the installation conditions of the construction product and the release scenarios resulting from there.
  - In addition to the specific clauses relating to dangerous substances contained in this European Technical Assessment, there may be other requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.
- 4) The use category of SikaSeal-629 Fire Wrap+ in relation to BWR 3 (Hygiene, health and environment) is IA1, S/W3

#### 2 Specification of the intended uses of the product in accordance with the applicable European Assessment Document (Hereinafter EAD): EAD 350454-00-1104

Detailed information and data is given in Annex A.

The intended use of system SikaSeal-629 Fire Wrap+ is to reinstate the fire resistance performance of flexible wall and rigid wall and floor constructions, where they are penetrated by services.

1) The specific elements of construction that the system SikaSeal-629 Fire Wrap+ may be used to provide a penetration seal in, are as follows:

Flexible walls: The wall must have a minimum thickness of 100 mm and comprise steel studs

or timber studs\* lined on both faces with minimum 2 layers of 12.5 mm thick

boards

Rigid walls: The wall must have a minimum thickness of 100 mm and comprise concrete,

aerated concrete or masonry, with a minimum density of 650 kg/m3.

Rigid floors: The floor must have a minimum thickness of 150 mm and comprise aerated

concrete or concrete with a minimum density of 650 kg/m3.

The supporting construction must be classified in accordance with EN 13501-2 for the required fire resistance period.

2) Aperture sizes are given in Appendix A. Under EN 1366-3 rules, results from tests in floors with a penetration seal length of minimum 1000 mm apply to any length as long as the perimeter length to seal area ratio is not smaller than that of the tested penetration seal. The following aperture sizes are therefore allowed where 2400 mm x 1200 mm is described in floors:

Maximum Aperture Sizes within Floors or Between Floors and Walls		
1200 mm width x 2400 mm length (tested)		
1100 mm width x 2900 mm length		
1000 mm width x 4000 mm length		
900 mm width x 7000 mm length		
≤800 mm width x ∞ (infinite) length		

- The system SikaSeal-629 Fire Wrap+ may be used to provide a penetration seal with specific supporting constructions and substrates (for details see Annex A).
- The provisions made in this European Technical Assessment are based on an assumed working life of the SikaSeal-629 Fire Wrap+ of 25 years, provided that the conditions laid down in the manufacturers datasheet and instructions for the packaging/transport/storage/installation/ use/repair are met. The indications given on the working life cannot be interpreted as a guarantee given by the producer or the Technical Assessment Body but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.
- 4) Type X: intended for use at conditions exposed to weathering.

<sup>\*</sup> no part of the penetration seal may be closer than 100 mm to a stud, the cavity must be closed between the penetration seal and the stud, and minimum 100 mm of insulation of class A1 or A2 according to EN 13501-1 must be provided within the cavity between the penetration seal and the stud.

#### 3 Performance of the product and references to the methods used for its assessment

Product-type: Pipe Wrap	Intended use: Penetration Seal
Essential characteristic	Product Performance
BWR 2 Safety	n case of fire
Reaction to fire	No performance assessed
Resistance to fire	Annex A
BWR 3 Hygiene, heal	th and environment
Air permeability	No performance assessed
Water permeability	No performance assessed
Content, emission and/or release of dangerous	Use categories: IA1, S/W3
substances	Declaration of manufacturer
BWR 4 Safe	ety in use
Mechanical resistance and stability	No performance assessed
Resistance to impact/movement	No performance assessed
Adhesion	No performance assessed
Durability	Х
BWR 5 Protectio	n against noise
Airborne sound insulation	No performance assessed
BWR 6 Energy econom	y and heat retention
Thermal properties	No performance assessed
Water vapour permeability	No performance assessed

### 4 ASSESSMENT AND VERIFICATION OF CONSTANCY OF PERFORMANCE (HEREINAFTER AVCP) SYSTEM APPLIED, WITH REFERENCE TO ITS LEGAL BASE

According to the decision 1999/454/EC – Commission Decision of date 22nd June 1999 on the procedure for attesting the conformity of construction products pursuant to Article 20(2) of Council Directive 89/106/EEC as regards fire stopping, fire sealing and fire protective products, published in the Official Journal of the European Union (OJEU) L178/52 of 14/07/1999, see http://eur-lex.europa.eu/JOIndex.do) of the European Commission<sup>1</sup>, as amended, the system(s) of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) given in the following table(s) applies (apply).

Product(s)	Intended use(s)	Level(s) or class(es)	System(s)
Fire stopping and Fire Sealing Products	For fire compartmentation and/or fire protection or fire performance	Any	1

### 5 <u>Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD</u>

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at ETA-Danmark A/S prior to CE marking

Issued in Copenhagen on 2021-11-25 by

**Thomas Bruun** 

Managing Director, ETA-Danmark


<sup>&</sup>lt;sup>1</sup> Official Journal of the European Communities L178/52 of 14/7/1999

#### ANNEX A - Resistance to Fire Classification - SikaSeal-629 Fire Wrap+

#### A.1 Rigid wall constructions with wall thickness of minimum 150 mm

## A.1.1 SikaSeal-629 Fire Wrap+ penetration seals, in 100 mm thick Sikacrete-630 Fire+ seals in rigid walls with insulated metal pipes

**Penetration Seal:** CS (Continuous Sustained) insulated metallic pipes fitted at any position within the aperture (min. separation 10 mm from seal edges), with 100 mm Sikacrete-630 Fire+ to either side of the wall. SikaSeal-629 Fire Wrap+ are required to be centrally within the seal for pipes with combustible insulation. Maximum seal size 2400 mm wide x 1200 mm high.

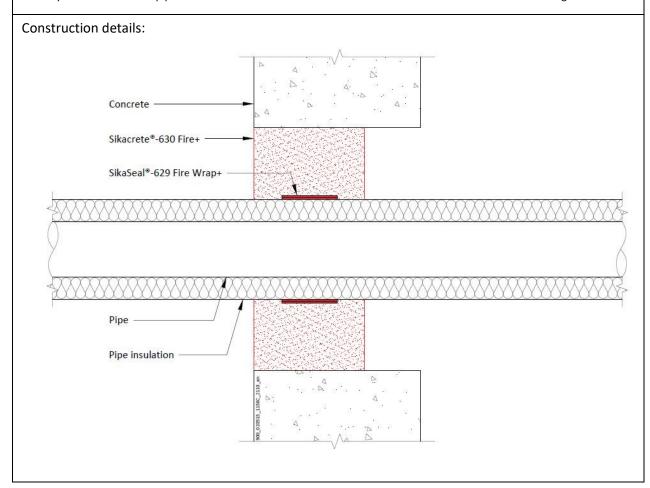


#### A.1.1.1

Services	Wrap	Insulation	Classification
Mild or stainless steel pipe			
40 mm diameter/1.5-14.2 mm wall		13 mm	
		Elastomeric	
		insulation	EI 240 C/U
	1 off 50 x 3.6mm	minimum class B-	2. 2 . 6 6, 6
	SikaSeal-629 Fire	s3,d0 or PE Foam	
	Wrap+, fitted	insulation	
165 mm diameter/4.5-14.2 mm wall	central	9 mm Elastomeric	
		insulation	
		minimum class B-	E 240 C/U, EI 30 C/U
		s3,d0 or PE Foam	
		insulation	
40 mm diameter/1.5-14.2 mm wall*			
50 mm diameter/1.6-14.2 mm wall*			
60 mm diameter/1.7-14.2 mm wall*		42.40	
75 mm diameter/1.9-14.2 mm wall*	1 off 50 x 1.8mm	13 -19 mm Elastomeric	
90 mm diameter/2-14.2 mm wall*	SikaSeal-629 Fire Wrap+, fitted	insulation minimum class B-	E 240 C/U, EI 60 C/U
100 mm diameter/2.1-14.2 mm wall*	central	s3,d0 or PE Foam	2 240 0, 0, 2, 00 0, 0
115 mm diameter/2.3-14.2 mm wall*		insulation	
140 mm diameter/2.6-14.2 mm wall*			
165 mm diameter/2.8-14.2 mm wall*			

<sup>\*</sup> Typical pipe diameters shown, see below graph for intermediate sizes



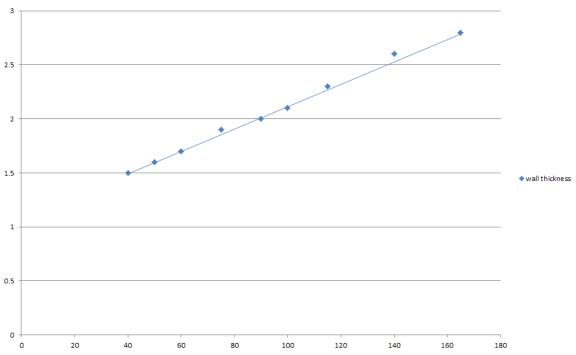


#### A.1.1.2

Services	Wrap	Insulation	Classification
Mild or stainless steel pipe			
40 mm diameter/1.5-14.2 mm wall*			
50 mm diameter/1.8-14.2 mm wall*			
60 mm diameter/2-14.2 mm wall*		13-25 mm	
75 mm diameter/2.3-14.2 mm wall*	1 off 50 x 3.6mm	Elastomeric	
90 mm diameter/2.7-14.2 mm wall*	SikaSeal-629 Fire Wrap+, fitted	insulation minimum class B-	E 180 C/U, EI 60 C/U
100 mm diameter/2.9-14.2 mm wall*	central	s3,d0 or PE Foam	33 4, 3, 33 4,
115 mm diameter/3.3-14.2 mm wall*		insulation	
140 mm diameter/3.9-14.2 mm wall*			
165 mm diameter/4.5-14.2 mm wall*			


<sup>\*</sup> Typical pipe diameters shown, see below graph for intermediate sizes

### Pipe diameter vs Wall thickness

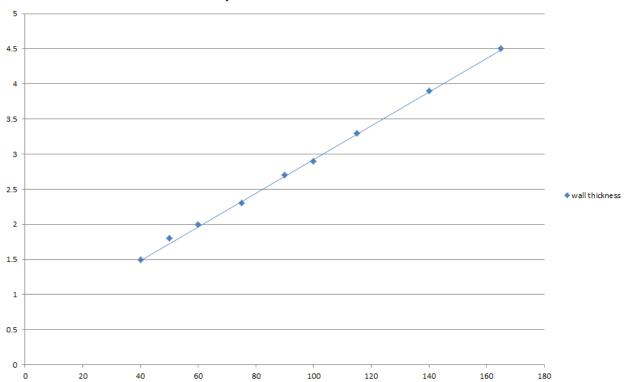

# A.1.2 SikaSeal-629 Fire Wrap+ penetration seals, in 100 mm thick Sikacrete-630 Fire+ seals in rigid walls with plastic pipes

**Penetration Seal:** plastic pipes fitted at any position within the aperture (min. separation 10 mm from seal edges), with 100 mm Sikacrete-630 Fire+ to either side of the wall. SikaSeal-629 Fire Wrap+ are required to be centrally within the seal. Maximum seal size 2400 mm wide x 1200 mm high

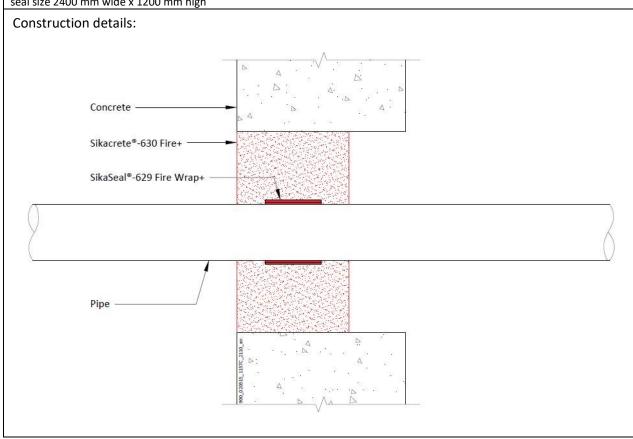


#### A.1.2.1

Services	Wrap	Insulation	Classification
PVC-U pipe according to EN 1329-1,			
EN 1452-1 and EN 1453-1 and			
PVC-C according to EN 1566-1			
315 mm diameter/9.2 mm wall	1 off 75 x 18 mm		EI 120 C/C
	SikaSeal-629 Fire	None	El 120 C/C
	Wrap+, fitted	None	
	central		

#### A.2 Rigid floor constructions with a minimum thickness 150 mm

## A.2.1 SikaSeal-629 Fire Wrap+ penetration seals, in 100 mm thick Sikacrete-630 Fire+ seals in rigid floors, with insulated metal pipes

**Penetration Seal:** CS (Continuous Sustained) insulated metallic pipes fitted at any position within the aperture (min. separation 25 mm from seal edges and 30 mm from other services), with 100 mm Sikacrete-630 Fire+ at any position within the floor. SikaSeal-629 Fire Wrap+ are required to be fitted around combustible pipe insulation. Maximum seal size 1200 x 2400 mm.

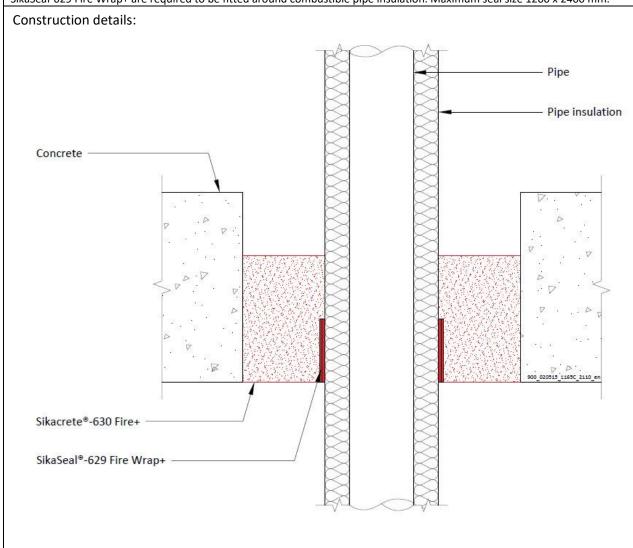


#### A.2.1.1

Services	Wrap	Insulation	Classification
Copper pipe			
12 mm diameter/1 mm wall	50 x 3.6 mm SikaSeal-	9 mm Elastomeric insulation minimum class B-s3,d0 or foil faced Phenolic Foam insulation	EI 240 C/C
12-54 mm diameter/1-1.2 mm wall	629 Fire Wrap+ fitted to the soffit	13-25 mm Elastomeric insulation minimum class B-s3,d0 or foil faced Phenolic Foam insulation	E 240 C/C, EI 60 C/C
Geberit Mepla MLC (PE-Xb/Aluminium	/PE-HD pipe) I	9 mm Elastomeric	
16 mm diameter/2.25 mm wall		insulation minimum class B-s3,d0 or foil faced Phenolic Foam insulation	EI 240 C/C
16 mm diameter/2.25 mm wall			
20 mm diameter/2.5 mm wall			
26 mm diameter/3 mm wall		9-13 mm Elastomeric	
32 mm diameter/3 mm wall		insulation minimum	
40 mm diameter/3.5 mm wall		class B-s3,d0 or foil faced Phenolic Foam	E 240 C/C, EI 90 C/C
50 mm diameter/4 mm wall	50 x 3.6 mm SikaSeal-	insulation	
63 mm diameter/4.5 mm wall	629 Fire Wrap+ fitted		
75 mm diameter/4.7 mm wall	to the soffit		
16 mm diameter/2.25 mm wall			
20 mm diameter/2.5 mm wall			
26 mm diameter/3 mm wall		13-25 mm	
32 mm diameter/3 mm wall		Elastomeric insulation minimum	5 4 00 0 /0 51 00 0 /3
40 mm diameter/3.5 mm wall		class B-s3,d0 or foil	E 180 C/C, EI 90 C/C
50 mm diameter/4 mm wall		faced Phenolic Foam insulation	
63 mm diameter/4.5 mm wall			
75 mm diameter/4.7 mm wall			

# A.2.2 SikaSeal-629 Fire Wrap+ penetration seals, in 100 mm thick Sikacrete-630 Fire+ seals in rigid floors, with insulated metal pipes


**Penetration Seal:** CS (Continuous Sustained) insulated metallic pipes fitted at any position within the aperture (min. separation 30 mm from seal edges and 30 mm from other services), with 100 mm Sikacrete-630 Fire+ to the top surface of the floor. SikaSeal-629 Fire Wrap+ are required to be fitted around combustible pipe insulation. Maximum seal size 2400 mm x 1200 mm.

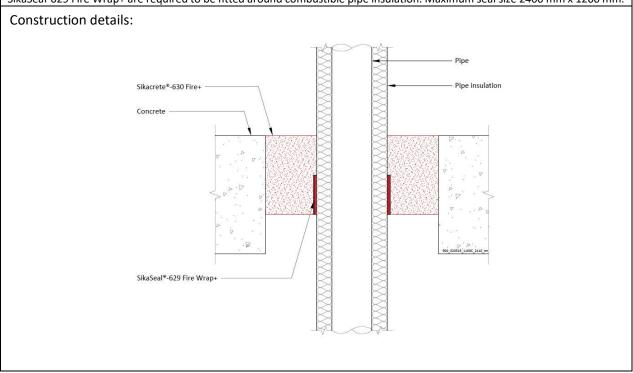


#### A.2.2.1

Services	Wrap	Insulation	Classification
Mild or stainless steel pipe			
40 mm diameter/-14.2 mm wall		13 mm	
		Elastomeric	
		insulation	
		minimum class B-	EI 180 C/U
		s3,d0 or foil faced	
		Phenolic Foam	
		insulation	
40 mm diameter/1.5-14.2 mm wall*	1 off 50 x 1.8 mm		
50 mm diameter/1.6-14.2 mm wall*	SikaSeal-629 Fire	12.10	
60 mm diameter/1.7-14.2 mm wall*	Wrap+, fitted at	13 -19 mm	
75 mm diameter/1.9-14.2 mm wall*	soffit	Elastomeric insulation	
90 mm diameter/2-14.2 mm wall*		minimum class B-	
100 mm diameter/2.1-14.2 mm wall*		s3,d0 or foil faced	E 180 C/U, EI 120 C/U
115 mm diameter/2.3-14.2 mm wall*		Phenolic Foam insulation	
140 mm diameter/2.6-14.2 mm wall*		insulation	
165 mm diameter/2.8-14.2 mm wall*			


<sup>\*</sup> Typical pipe diameters shown, see below graph for intermediate sizes



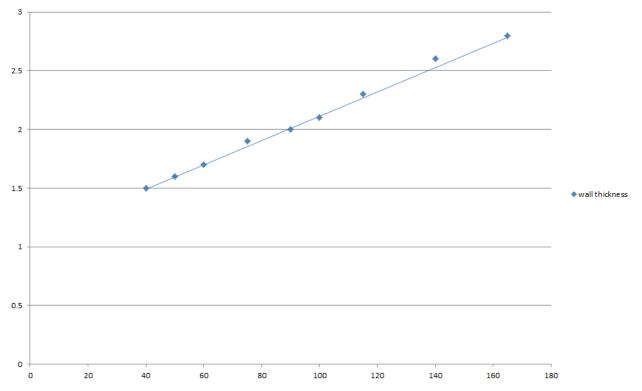


# A.2.3 SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in Sikacrete-630 Fire+ Seal, in rigid floors

**Penetration Seal:** CS (Continuous Sustained) insulated metallic pipes sealed with SikaSeal-629 Fire Wrap+, fitted at any position within the aperture, with 100 mm Sikacrete-630 Fire+ Seal. Minimum separation between penetration seals and seal edges of 30 mm (Configuration 1 & 2).

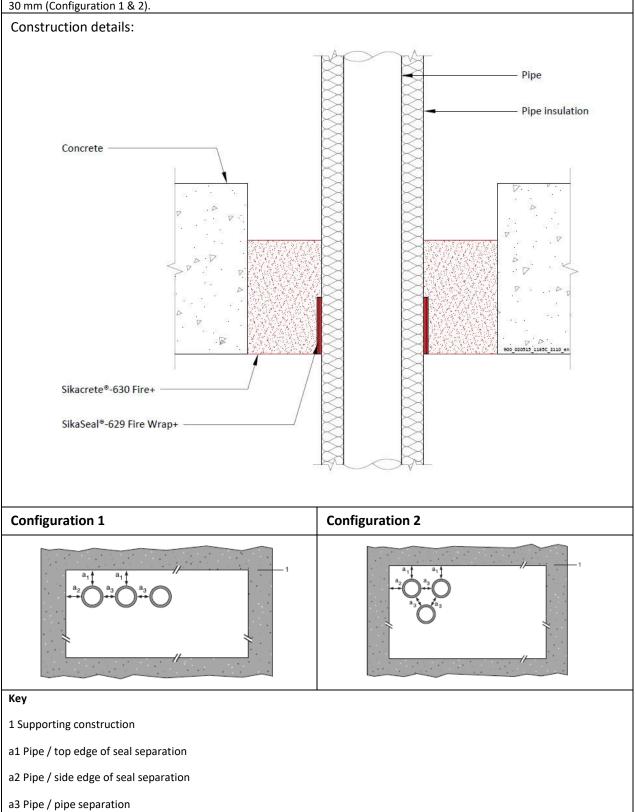


#### A.2.3.1

Mild or stainless steel pipe	Insulation	SikaSeal-629 Fire Wrap+	Classification
40 mm diameter/1-14.2 mm wall	25 mm thick Elastomeric insulation minimum class B- s3,d0 or foil faced Phenolic Foam insulation		EI 240 C/U
40 mm diameter/1-14.2 mm wall*			
50 mm diameter/1.2-14.2 mm wall*			
60 mm diameter/1.4-14.2 mm wall*			
75 mm diameter/1.6-14.2 mm wall*			
90 mm diameter/1.9-14.2 mm wall*			
100 mm diameter/2.1-14.2 mm wall*			
115 mm diameter/2.4-14.2 mm wall*	25mm thick Elastomeric	50 x 3.6 mm (2 x 1.8 layer)	
140 mm diameter/2.9-14.2 mm wall*	insulation minimum class B-	(	E 240 C/U
165 mm diameter/ 3.4-14.2 mm wall*	s3,d0 or foil faced Phenolic Foam insulation		EI 120 C/U
180 mm diameter/ 3.6-14.2 mm wall*	, 6464.4		
200 mm diameter/ 4.0-14.2 mm wall*			
219 mm diameter/ 4.3-14.2 mm wall*			
250 mm diameter/ 5.0-14.2 mm wall*			
300 mm diameter/ 5.9-14.2 mm wall*			
324 mm diameter/ 6.35-14.2 mm wall*			
40 mm diameter/1-14.2 mm wall*			
50 mm diameter/1.2-14.2 mm wall*			
60 mm diameter/1.4-14.2 mm wall*			
75 mm diameter/1.6-14.2 mm wall*			
90 mm diameter/1.9-14.2 mm wall*			
100 mm diameter/2.1-14.2 mm wall*			
115 mm diameter/2.4-14.2 mm wall*	25-50mm thick Elastomeric		
140 mm diameter/2.9-14.2 mm wall*	insulation minimum class B-	50 x 5.4 mm	EI 120 C/U
165 mm diameter/ 3.4-14.2 mm wall*	s3,d0 or foil faced Phenolic Foam insulation	(3 x 1.8 layer)	, ,
180 mm diameter/ 3.6-14.2 mm wall*			
200 mm diameter/ 4.0-14.2 mm wall*			
219 mm diameter/ 4.3-14.2 mm wall*			
250 mm diameter/ 5.0-14.2 mm wall*			
300 mm diameter/ 5.9-14.2 mm wall*			
324 mm diameter/ 6.35-14.2 mm wall*			

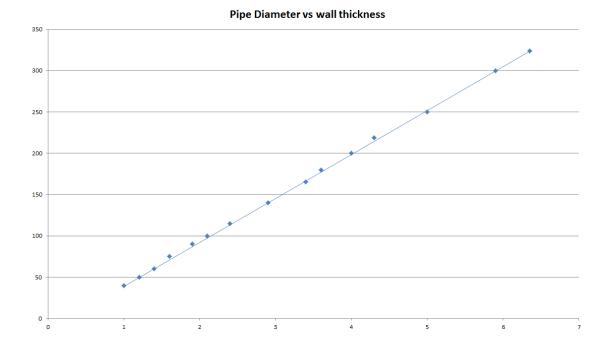

# A.2.4 SikaSeal-629 Fire Wrap+ penetration seals, in 100 mm deep Sikacrete-630 Fire+ seals in rigid floors, with plastic pipes

**Penetration Seal:** Plastic pipes fitted at any position within the aperture, with 100 mm Sikacrete-630 Fire+ to the either surface of the floor or anywhere between. SikaSeal-629 Fire Wrap+ are required to be fitted to the bottom of the seal, as indicated below. Minimum separation between penetration seals and seal edges of 30 mm (Configuration 1 & 2).

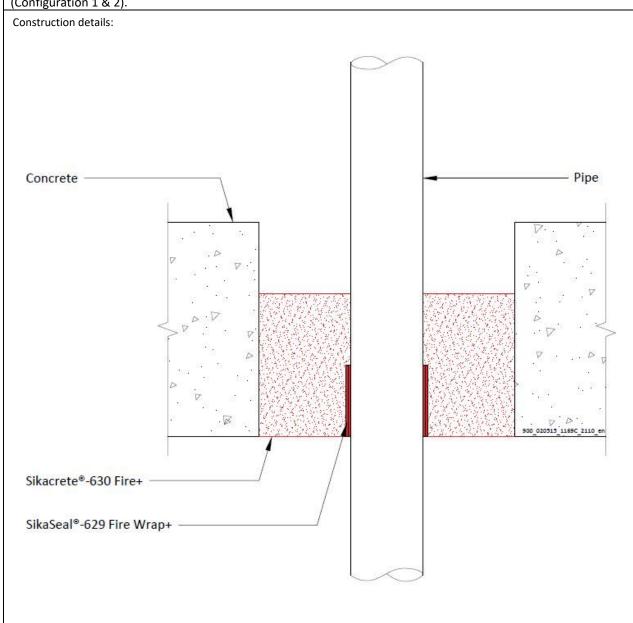


#### A.2.4.1


a3 Pipe / pipe separation

		1	
Services	Wrap	Maximum aperture	Classification
PVC-U pipe according to EN 1329-1, EN 1452-1 and	EN 1453-1, PVC	-C according to E	
Up to 40 mm diameter / 1.8-3.7 mm wall	50 x 1.8 mm		E 180 U/U, EI 120 U/U
Up to 110 mm diameter / 3.0-6.6 mm wall	50 x 3.6 mm		EI 240 U/C
Up to 125 mm diameter / 3.5-7.4 mm wall	50 x 7.2 mm	2400 x 1200	EI 120 U/C
Up to 160 mm diameter / 4.5 mm wall	50 x 10.8 mm	mm	EI 240 C/C
Up to 160 mm diameter / 4.5-9.5 mm wall	50 x 10.8 mm		EI 90 C/C
Up to 110 mm diameter/ 2.7-6.6 mm wall, containing up to 90mm Ø bundle of up to 14 mm Ø telecom cables	50 x 3.6 mm		EI 120 U/C
PP pipe according to EN 1451-1			
Up to 40 mm diameter /1.8-4.4 mm wall	None		EI 120 U/C
Up to 40 mm diameter /1.8-5.5 mm wall	50 x 1.8 mm		EI 120 U/U
Up to 50 mm diameter /2.5-5.5 mm wall	50 x 3.6 mm		EI 240 C/C
Up to 75 mm diameter /3.5-5.5 mm wall	50 x 3.6 mm	2400 x 1200	EI 240 C/C
Up to 110 mm diameter /2.7-6.3 mm wall	50 x 3.6 mm	mm	EI 240 U/C
Up to 125 mm diameter /3.4-11.4 mm wall	50 x 7.2 mm		EI 240 U/C
Up to 160 mm diameter /4.9-14.6 mm wall	50 x 10.8 mm		EI 240 U/C
Up to 110 mm diameter/ 3.4-6.3 mm wall, containing up to 90mm Ø bundle of up to 14 mm Ø telecom cables	50 x 3.6 mm		EI 60 U/C
From SAN+PVC according to EN 1565-1  Up to 40 mm diameter / 2.0-4.4 mm wall	None		EI 120 U/C
Up to 40 mm diameter / 2.4-3.7 mm wall	50 x 1.8 mm	_	EI 240 U/U
Up to 110 mm diameter / 3.4-10.0 mm wall	50 x 3.6 mm	2400 4200	EI 120 U/C
Up to 125 mm diameter / 3.9-11.4 mm wall	50 x 7.2 mm	2400 x 1200	EI 240 U/C
Up to 160 mm diameter / 4.9-14.6 mm wall	50 x 10.8 mm	mm	EI 120 U/C
Up to 250 mm diameter / 7.8 mm wall	75 x 12.6 mm		EI 180 C/C
Up to 110 mm diameter/ 2.7-10.0 mm wall, containing up to 90mm Ø bundle of up to 14 mm Ø telecom cables	50 x 3.6 mm		E 120 U/C, EI 60 U/C
Configuration 1	Configura	ition 2	
$\begin{array}{c} a_1 \downarrow & a_1 \downarrow \\ a_2 & a_3 \\ \end{array} \begin{array}{c} a_3 \downarrow \\ \end{array} \begin{array}{c} a_3 \\ \end{array} \begin{array}{c} $			1
Key			
1 Supporting construction 1 Pipe / top edge of seal separation			




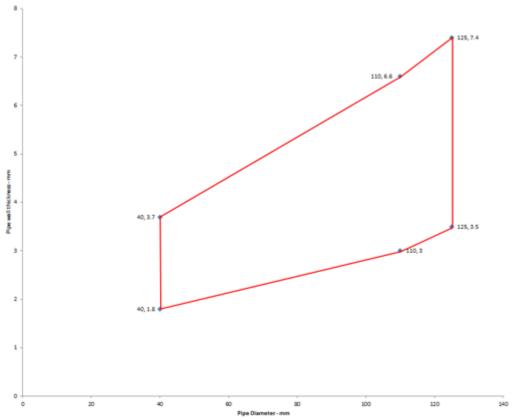



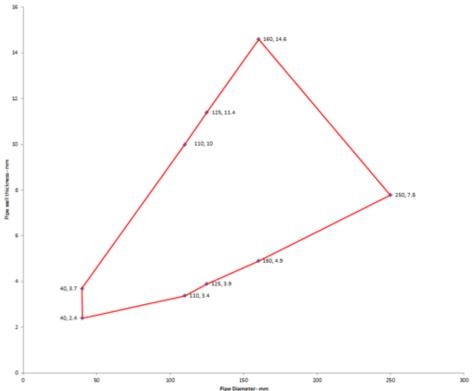




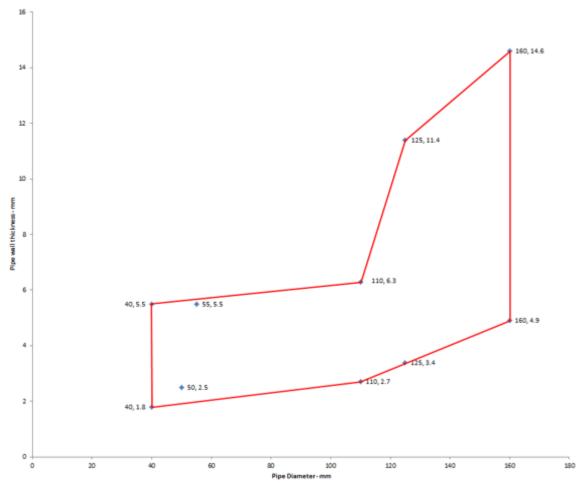

# A.2.5 SikaSeal-629 Fire Wrap+ penetration seals, in 100 mm thick Sikacrete-630 Fire+ seals in rigid floors, with plastic pipes

**Penetration Seal:** Plastic pipes fitted at any position within the aperture (min. separation 30 mm from seal edges and from other services), with 100 mm Sikacrete-630 Fire+ to the bottom surface of the floor. SikaSeal-629 Fire Wrap+ are required to be fitted to the bottom of the seal, as indicated below. Maximum seal size 2400 mm x 1200 mm.

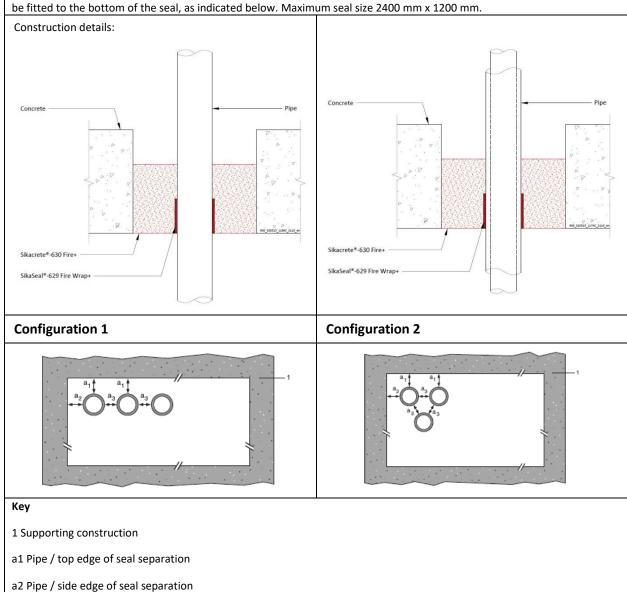


a3 Pipe / pipe separation

#### A.2.5.1


Services	Wrap	Permitted	Classification			
Jei Vices	vviap	configuration for	Ciassification			
		seal separation				
PVC-U pipe according to EN 1329-1, EN 1452-	PVC-U pipe according to EN 1329-1, EN 1452-1 and EN 1453-1, PVC-C according to EN 1566-1					
	50 x 10.8 mm (6 x	1 & 2	EI 90 U/C			
160 mm diameter / 9.5 mm wall	1.8 layers)					
Uponor Wirsbo PEX pipe in pipe system according to ISO 15875						
Maximum 54 mm diameter/0.4 mm						
wall thickness (outer pipe), 28 mm	50 x 3.6 mm (2 x	1 & 2	EI 120 C/C			
diameter/4.0 mm wall thickness (inner	1.8 layers)	1 & 2	E1 120 C/C			
pipe)						
Rehau Raupiano Plus PP-DD according to	DIN 4102					
40-50 mm diameter/1.8-2.7 mm wall	50 x 3.6 mm (2 x	1 & 2	EI 120 U/U			
thickness*	1.8 layers)		11120 0/0			
75-110 mm diameter/2.7 mm wall	50 x 3.6 mm (2 x	1 & 2	EI 120 U/C			
thickness*	1.8 layers)					
125 mm diameter/3.1 mm wall	50 x 7.2 mm (4 x	1 & 2	E 240 U/C, EI 120			
thickness	1.8 layers)		U/C			
160 mm diameter/3.9 mm wall	50 x 10.8 mm (6 x	1 & 2	EI 120 U/C			
thickness	1.8 layers)		11120 0/ 0			
	Polo-Kal NG Poloplast PP-MV according to DIN 4102					
32-110 mm diameter/3.4 mm wall	50 x 3.6 mm (2 x	1 & 2	EI 180 U/C			
thickness	1.8 layers)		2.1000/0			
125 mm diameter/3.9 mm wall	50 x 7.2 mm (4 x	1 & 2	EI 240 U/C			
thickness	1.8 layers)		2.12-10-0/-0			
160 mm diameter/4.3 mm wall	50 x 10.8 mm (6 x	1 & 2	EI 240 U/C			
thickness	1.8 layers)		2.2.00,0			
Aquatherm Green SDR9 MF PP-RP according to ISO 21003						
32 mm diameter/3.6 mm wall thickness	50 x 1.8 mm (1 x	1 & 2	EI 240 C/C			
	1.8 layer)		=: = :0 0, 0			
40-50 mm diameter/5.6-12.3 mm wall	50 x 3.6 mm (2 x	1 & 2	EI 240 C/C			
thickness*	1.8 layers)					
63-110 mm diameter/12.3 mm wall	50 x 3.6 mm (2 x	1 & 2	EI 240 C/C			
thickness*	1.8 layers)		,			
Wavin SiTech + PP-M B according to EN 1						
32-50 mm diameter/1.8-3.4 mm wall	50 x 3.6 mm (2 x	1 & 2	EI 120 U/U			
thickness*	1.8 layers)		•			
75-110 mm diameter/3.4 mm wall	50 x 3.6 mm (2 x	1 & 2	EI 120 U/C			
thickness*	1.8 layers)		•			
Gilbert Silent PP according to DIN 4102	FO 2 C /2					
32-50 mm diameter/1.8-3.4 mm wall	50 x 3.6 mm (2 x	1 & 2	EI 120 U/U			
thickness*	1.8 layers)	402				
75-110 mm diameter/3.4 mm wall	50 x 3.6 mm (2 x	1 & 2	EI 120 U/C			
thickness*	1.8 layers)					

<sup>\*</sup> Typical pipe diameters shown, see below graph for intermediate sizes


### Rehau Raupiano Plus -EI 120 U/U

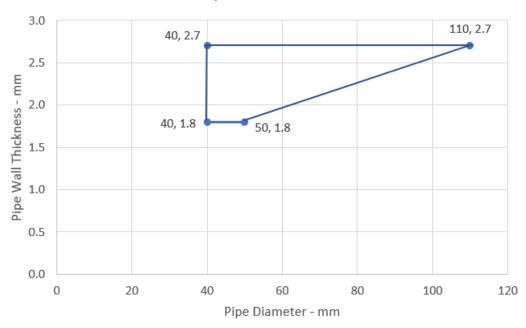


### Aquatherm Green - EI 240 C/C

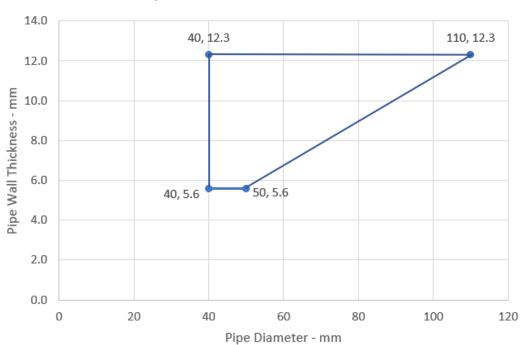

### Wavin SiTech Pipes - El 120 U/C

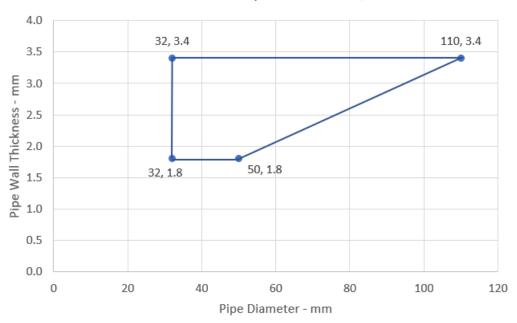


### Gilbert Silent PP - EI 120 U/C

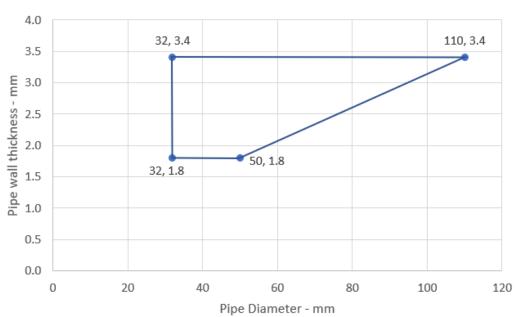

# A.2.6 SikaSeal-629 Fire Wrap+ penetration seals, in Sikacrete-630 Fire+ seals in rigid floors, with plastic pipes

**Penetration Seal:** Plastic pipes fitted at any position within the aperture (min. separation 30 mm from seal edges and from other services), with Sikacrete-630 Fire+ to the bottom surface of the floor. SikaSeal-629 Fire Wrap+ are required to be fitted to the bottom of the seal, as indicated below. Maximum seal size 2400 mm x 1200 mm.

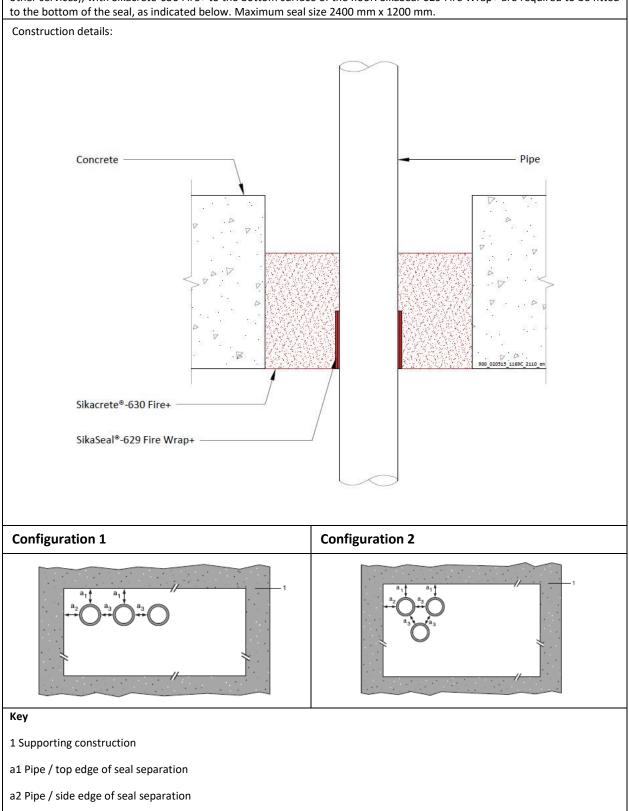

a3 Pipe / pipe separation


### A.2.6.1

Services	Wrap	Permitted configuration for	Mortar depth	Classification		
seal separation SNG Consequence SN 1330 1 SN 1453 1 and SN 1453 1 SNG Consequence SN 1566 1						
PVC-U pipe according to EN 1329-1, EN 1452-1 and EN 1453-1, PVC-C according to EN 1566-1           Diameter 41 mm, wall         50 x 7.2 mm (4 x						
thickness 1.8-3.7 mm to diameter 125 mm, wall thickness 4.8-7.4 mm*	50 x 7.2 mm (4 x 1.8 layers)	1 & 2	150 mm	EI 60 U/U		
125 mm diameter / 7.4 mm wall	50 x 7.2 mm (4 x 1.8 layers)	1 & 2	150 mm	EI 120 U/U		
Diameter 126 mm, wall thickness 4.8-7.4 mm to diameter 160 mm, wall thickness 9.5 mm*	75 x 10.8 mm (6 x 1.8 layers)	1	150 mm	E 120 U/U, EI 30 U/U		
160 mm diameter / 9.5 mm wall	75 x 7.2 mm (4 x 1.8 layers)	1	150 mm	E 120 U/U, EI 30 U/U		
160 mm diameter / 4.5-9.5 mm wall thickness	50 x 10.8 mm (6 x 1.8 layers)	1 & 2	120 mm	EI 120 U/C, EI 120 C/C		
315 mm diameter / 7.7 mm wall thickness	75 x 18 mm (10 x 1.8 layers)	1	120 mm	EI 120 C/C		
Diameter 161 mm, wall thickness 4.5-9.5 mm to diameter 315 mm, wall thickness 7.7-12.1 mm*	75 x 18 mm (10 x 1.8 layers)	1	120 mm	EI 90 C/C		
315 mm diameter / 12.1 mm wall thickness	75 x 18 mm (10 x 1.8 layers)	1	120 mm	EI 90 C/C		
PP pipe according to EN 1451-1						
Diameter 41 mm, wall thickness 1.8-5.5 mm to diameter 160 mm, wall thickness 4.9-14.6 mm*	75 x 10.8 mm (6 x 1.8 layers)	1 & 2	150 mm	EI 120 U/C		
160 mm diameter / 14.6 mm wall	75 x 7.2 mm (4 x 1.8 layers)	1 & 2	150 mm	EI 240 U/U		
Diameter 161 mm, wall thickness 4.9-14.6 mm to diameter 200 mm, wall thickness 4.9-18.2 mm*	75 x 10.8 mm (6 x 1.8 layers)	1 & 2	120 mm	EI 240 C/C		
Diameter 201 mm, wall thickness 4.9-18.2 mm to diameter 315 mm, wall thickness 7.7-28.6 mm*	75 x 18 mm (10 x 1.8 layers)	N/A	150 mm	EI 60 C/C		
315 mm diameter / 7.7 mm wall	75 x 18 mm (10 x 1.8 layers)	N/A	150 mm	EI 180 C/C		
315 mm diameter / 7.7-28.6 mm wall	75 x 18 mm (10 x 1.8 layers)	1	150 mm	EI 60 C/C		


Services	Wrap	Permitted configuration for seal separation	Mortar depth	Classification	
PE pipe according to EN 1519-1, EN 12201-2 and EN 12666-1, ABS according to EN 1455-1 and pipes made					
from SAN+PVC according to EN 1565-1					
Diameter 126 mm, wall thickness 3.9-11.4 mm to diameter 160 mm, wall thickness 14.6*	75 x 18 mm (10 x 1.8 layers)	N/A	150 mm	E 240 U/U, EI 120 U/U	
160 mm diameter / 14.6 mm wall	75 x 7.2 mm (4 x 1.8 layers)	1 & 2	150 mm	E 240 U/U, EI 120 U/U	
Diameter 161 mm, wall thickness 4.9-14.6 mm to diameter 315 mm, wall thickness 9.7-18.7 mm*	75 x 18 mm (10 x 1.8 layers)	N/A	150 mm	EI 60 C/C	


<sup>\*</sup> Typical pipe diameters shown, see below graph for intermediate sizes

PVC-U Pipes 41-125 mm Diameter - EI 60 U/U

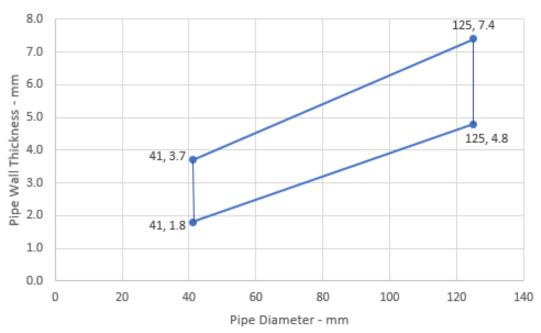


PVC-U Pipes 126-160 mm Diameter - E 120 U/U, EI 30 U/U

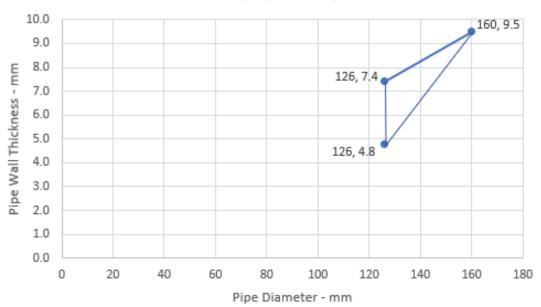

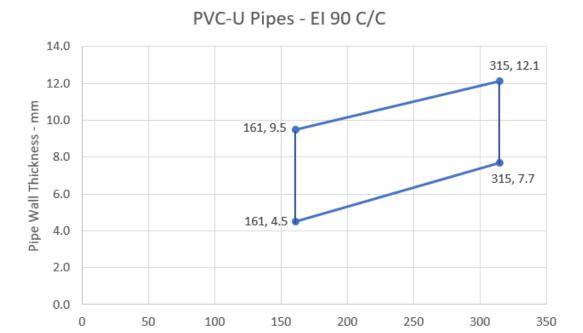





Pipe Diameter - mm

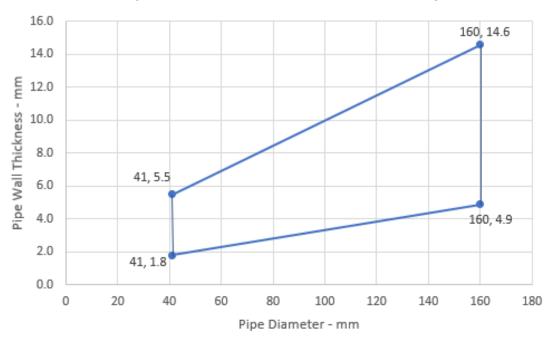




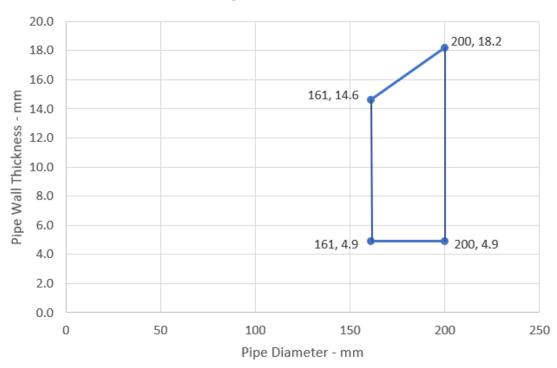


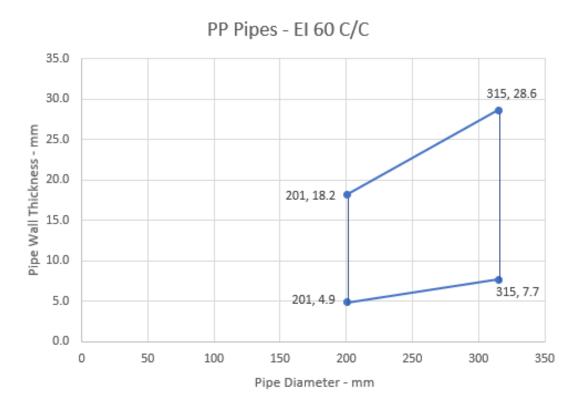

### PE Pipes 126-160 mm Diameter -E 240 U/U, EI 120 U/U

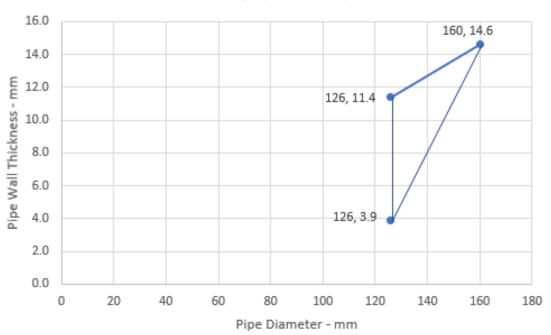




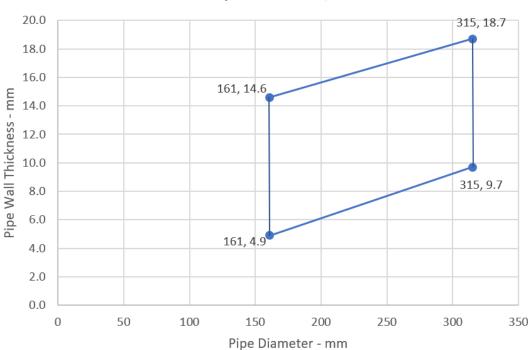

# A.2.7 SikaSeal-629 Fire Wrap+ penetration seals, in 150 mm thick Sikacrete-630 Fire+ seals in rigid floors, with plastic pipes

**Penetration Seal:** Plastic pipes fitted at any position within the aperture (min. separation 30 mm from seal edges and from other services), with 150 mm Sikacrete-630 Fire+ to the bottom surface of the floor. SikaSeal-629 Fire Wrap+ are required to be fitted to the bottom of the seal, as indicated below. Maximum seal size 2400 mm x 1200 mm.

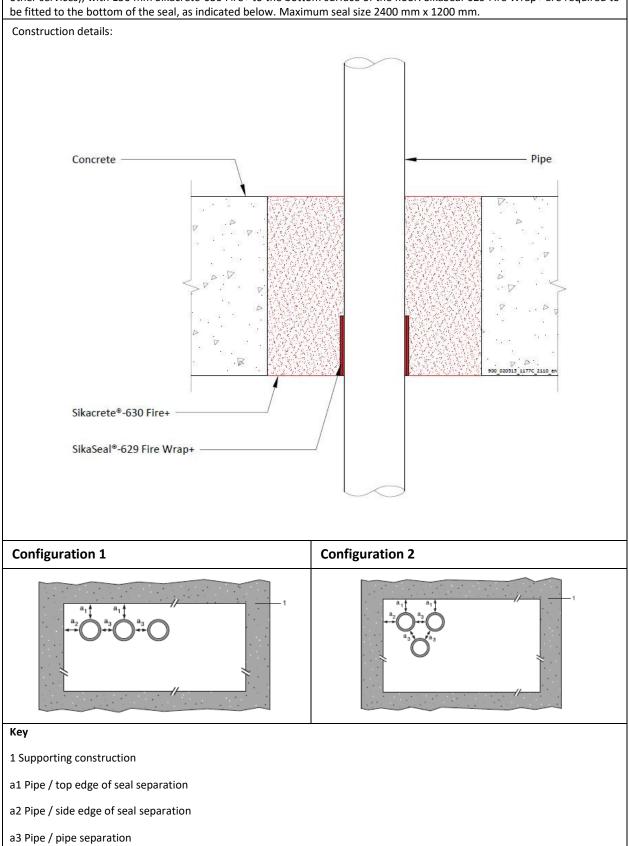


#### A.2.7.1


Services	Wrap	Permitted configuration for seal separation	Classification		
PVC-U pipe according to EN 1329-1, EN 1452-1 and EN 1453-1, PVC-C according to EN 1566-1					
Up to 40 mm diameter/1.8-3.7 mm wall*	50 x 1.8		EI 120 U/U		
Up to 125 mm diameter / 4.8-7.4 mm wall*	50 x 7.2 mm	1 & 2	EI 60 U/U		
Up to 160 mm diameter/9.5 mm wall*	75 x 7.2 mm		E 120 U/U, EI 30 U/U		
PP pipe according to EN 1451-1					
Up to 40 mm diameter/1.8-5.5 mm wall*	50 x 1.8	1 & 2	EI 120 U/U		
Up to 125 mm diameter / 11.4 mm wall*	50 x 7.2 mm		EI 240 U/U		
Up to 160 mm diameter/14.6 mm wall*	75 x 7.2 mm		EI 240 U/U		
PE pipe according to EN 1519-1, EN 12201-2 and EN 12666-1, ABS according to EN 1455-1 and pipes made from SAN+PVC according to EN 1565-1					
Up to 40 mm diameter/2.4-3.7 mm wall*	50 x 1.8 mm	1 & 2	EI 240 U/U		
Up to 110 mm diameter/3.4-10 mm wall*	75 x 5.4 mm		EI 240 U/U		
Up to 125 mm diameter/11.4 mm wall*	50 x 7.2 mm		EI 240 U/U		
Up to 160 mm diameter/4.9-14.6 mm wall*	75 x 7.2 mm		EI 120 U/U		

<sup>\*</sup> Typical pipe diameters shown, see below graph for intermediate sizes


### PVC-U Pipes - E 60 U/U, EI 30 U/U

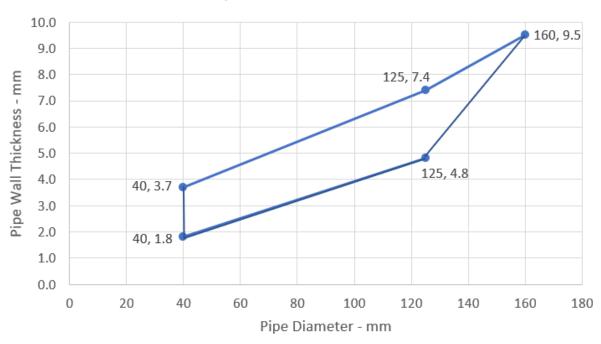



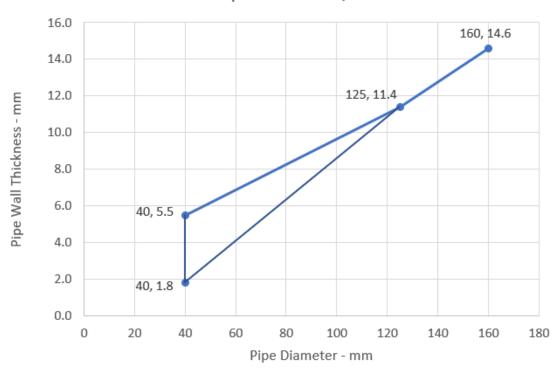




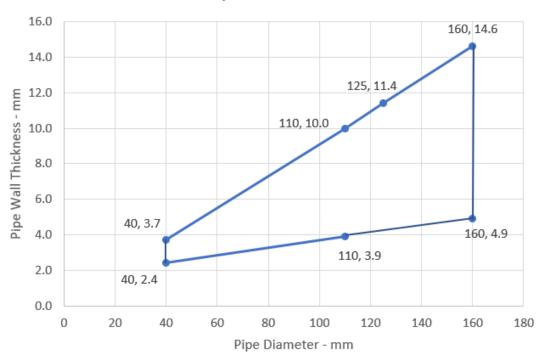

# A.2.8 SikaSeal-629 Fire Wrap+ penetration seals, in 50 mm deep Sikacrete-630 Fire+ seals, backed with 50 mm stone wool, in rigid floors, with plastic pipes

**Penetration Seal:** Plastic pipes (single) fitted at any position within the aperture (min. separation 30 mm from seal edges and 30 mm from other services), with 50 mm Sikacrete-630 Fire+ flush with the top of floor, backed with 50 mm stone wool 150 kg/m³. SikaSeal-629 Fire Wrap+ are required to be fitted into the mortar seal.

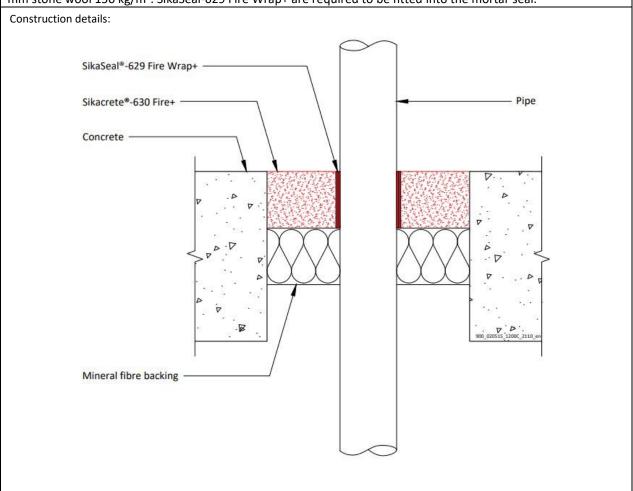


#### A.2.8.1

Services	Wrap	Maximum	Classification
		aperture	
PE pipe according to EN 1519-1, EN 12201-2 and EN 12666-1, ABS according to EN 1455-1 and pipes made from SAN+PVC according to EN 1565-1			
110 mm diameter / 4.3 mm wall	50 x 2 mm	2400 x 1200 mm	EI 60 C/C

#### A.3 Flexible and rigid wall constructions with a minimum thickness 100 mm

# A.3.1 SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in seals comprising 25 mm deep Sikacrete-630 Fire+ to both faces backed with 50 mm mineral fibre board, installed within flexible or rigid wall

**Penetration Seal:** CS (Continuous Sustained) insulated metallic pipes fitted at any position within the aperture (min. separation 30 mm from seal edges), with 25 mm Sikacrete-630 Fire+ to both sides of the wall, backed with 50 mm stone wool board 150 kg/m³ or 50 mm Sikacrete-630 Fire+ to both sides of the wall without backing\*. SikaSeal-629 Fire Wrap+ are required to be fitted to both faces of the seal.

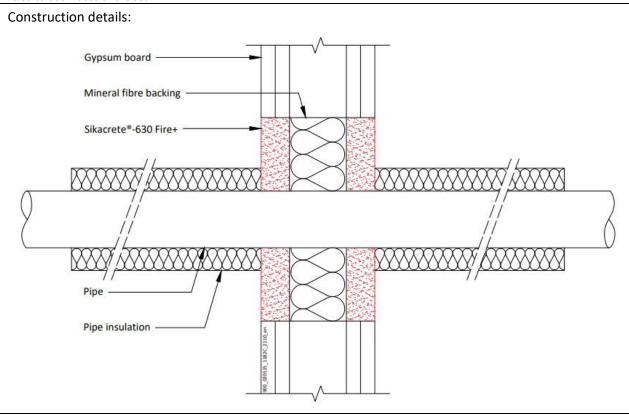



<sup>\*</sup> Maximum seal size of 2400 mm wide x 1200 mm high

#### A.3.1.1

Services	Wrap	Insulation	Classification				
Mild or stainless steel pipe							
40 mm diameter/1-14.2 mm wall	2 off 50 x 1.8 mm SikaSeal-629 Fire						
	Wrap+, one fitted		EI 120 C/U				
	flush to each face of						
	seal						
40 mm diameter/1-14.2 mm wall*							
50 mm diameter/1.3-14.2 mm wall*		13 mm Elastomeric					
60 mm diameter/1.6-14.2 mm wall*		insulation					
75 mm diameter/2-14.2 mm wall*	2 off 50 x 3.6 mm SikaSeal-629 Fire	minimum class B-s3,d0 or PE					
90 mm diameter/2.4-14.2 mm wall*	Wrap+, one fitted	Foam insulation	E 120 C/U, EI 60 C/U				
100 mm diameter/2.7-14.2 mm wall*	flush to each face of seal						
115 mm diameter/3.1-14.2 mm wall*							
140 mm diameter/3.8-14.2 mm wall*							
165 mm diameter/ 4.5-14.2 mm wall*							


<sup>\*</sup> Typical pipe diameters shown, see below graph for intermediate sizes



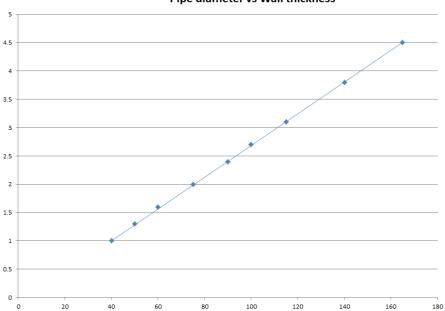

# A.3.2 SikaSeal-629 Fire Wrap+ penetration seal for composite pipes, in seals comprising 25 mm deep Sikacrete-630 Fire+ to both faces backed with 50 mm mineral fibre board, installed within flexible or rigid wall

**Penetration Seal:** 500 mm (min.)\* LI (Local Interrupted) or CI (Continuous Interrupted) insulated metallic (and composite) pipes (single) fitted at any position within the aperture (min. separation 30 mm from seal edges and from other services), with 25 mm Sikacrete-630 Fire+ to both sides of the wall backed with 50 mm stone wool board 150 kg/m3. Maximum seal size 2400 mm wide x 1200 mm high

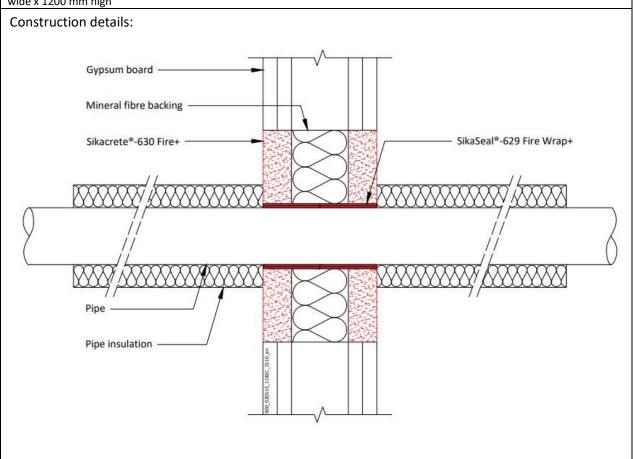


#### A.3.2.1

Services	Insulation	Classification
Geberit Mepla MLC (PE-Xb/Aluminium/PE-HD) pipe		
16 mm diameter/2.25 mm wall		
20 mm diameter/2.5 mm wall		
26 mm diameter/3 mm wall		
32 mm diameter/3 mm wall	Minimum 20 mm stone	EL 130 C/C
40 mm diameter/3.5 mm wall	wool, minimum 80 kg/m³	EI 120 C/C
50 mm diameter/4 mm wall		
63 mm diameter/4.5 mm wall		
75 mm diameter/4.7 mm wall		

# A.3.3 SikaSeal-629 Fire Wrap+ penetration seal for insulated metal & composite pipes, in seals comprising 25 mm deep Sikacrete-630 Fire+ to both faces backed with 50 mm mineral fibre board, installed within flexible or rigid wall

Penetration Seal: CS (Continuous Sustained) insulated metallic and composite pipes fitted at any position within the aperture (min. separation 25 mm from seal edges), with 25 mm Sikacrete-630 Fire+ to both sides of the wall, backed with 25 mm stone wool 150 kg/m3\*. SikaSeal-629 Fire Wrap+ are required to be fitted to both faces of the seal. Maximum seal size 2400 mm wide x 1200 mm long

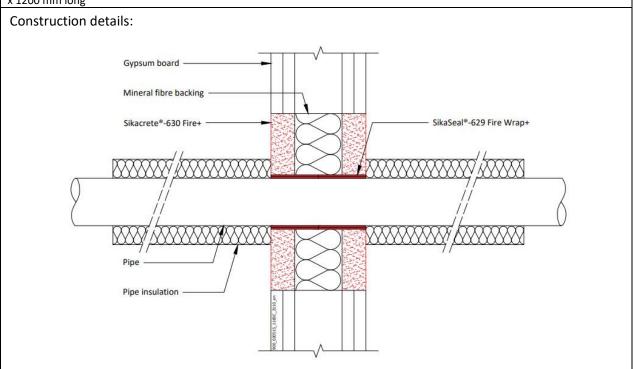


#### A.3.3.1

Services	Wrap	Insulation	Classification
Copper pipe			
12-54 mm diameter/1-1.2 mm wall	50 x 3.6 mm SikaSeal- 629 Fire Wrap+ fitted to both sides of the seal	9-25 mm Elastomeric insulation minimum class B-s3,d0 or PE Foam insulation	EI 120 C/C
Geberit Mepla MLC (PE-Xb/Aluminium	/PE-HD pipe)		
16 mm diameter/2.25 mm wall			
20 mm diameter/2.5 mm wall			
26 mm diameter/3 mm wall			
32 mm diameter/3 mm wall	50 x 3.6 mm SikaSeal- 629 Fire Wrap+ fitted	9-25 mm Elastomeric insulation minimum	FI 120 C/C
40 mm diameter/3.5 mm wall	to both sides of the	class B-s3,d0 or PE Foam insulation	EI 120 C/C
50 mm diameter/4 mm wall	seal	Foam insulation	
63 mm diameter/4.5 mm wall			
75 mm diameter/4.7 mm wall			

# A.3.4 SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in seals comprising 50 mm deep Sikacrete-630 Fire+ to both faces, installed within flexible or rigid wall

**Penetration Seal:** CS (Continuous Sustained) insulated metallic pipes fitted at any position within the aperture (min. separation 30 mm from seal edges), 50 mm Sikacrete-630 Fire+ to both sides of the wall without backing\*. SikaSeal-629 Fire Wrap+ are required to be fitted to both faces of the seal.

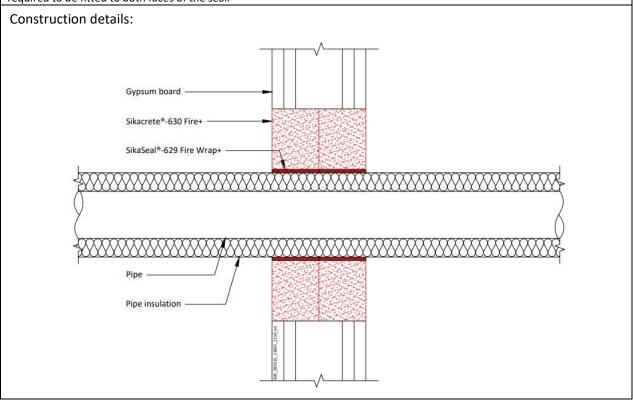

<sup>\*</sup> Maximum seal size of 2400 mm wide x 1200 mm high


#### A.3.4.1

Services	Wrap	Insulation	Classification	
Mild or stainless steel pipe				
40 mm diameter/1-14.2 mm wall*				
50 mm diameter/1.3-14.2 mm wall*				
60 mm diameter/1.6-14.2 mm wall*		13 -32 mm Elastomeric insulation		
75 mm diameter/2-14.2 mm wall*	2 off 50 x 3.6 mm			
90 mm diameter/2.4-14.2 mm wall*	SikaSeal-629 Fire Wrap+, one fitted			E 120 C/U, EI 60 C/U
100 mm diameter/2.7-14.2 mm wall*	flush to each face of seal	minimum class B-s3,d0 or PE	E 120 C/O, El 60 C/O	
115 mm diameter/3.1-14.2 mm wall*	Seal	Foam insulation		
140 mm diameter/3.8-14.2 mm wall*				
165 mm diameter/ 4.5-14.2 mm wall*				

<sup>\*</sup> Typical pipe diameters shown, see below graph for intermediate sizes

Page 45 of 68 of European Technical Assessment ETA-21/1032 issued on 2021-11-25


#### Pipe diameter vs Wall thickness

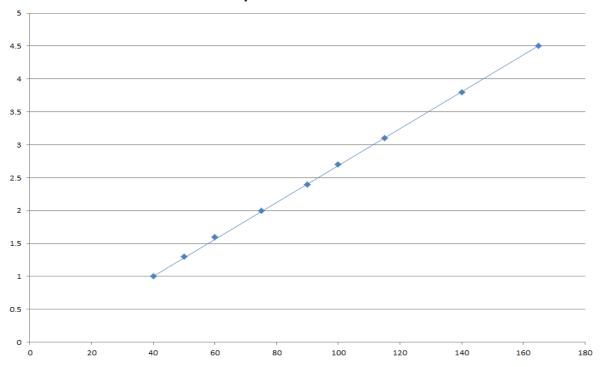

#### A.4 Rigid wall constructions with floor thickness of minimum 150 mm

### A.4.1 SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in 1x SikaSeal-626 Fire Board+ 2-S seals, in rigid walls


**Penetration Seal:** CS (Continuous Sustained) insulated metallic pipes fitted at any position within the aperture, with 60 mm SikaSeal-626 Fire Board+ 2-S to either side of the wall (or anywhere in between). SikaSeal-629 Fire Wrap+ are required to be fitted around combustible pipe insulation.

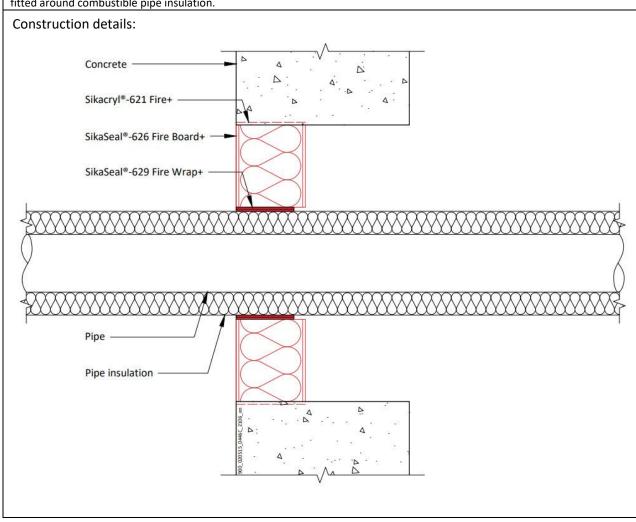

#### A.4.1.1

Services	Wrap	Insulation	Classification
Mild or stainless steel pipe			
165 mm diameter/ 4.5-14.2 mm		9-25 mm	
wall	50 x 1.8 mm SikaSeal- 629 Fire Wrap+ fitted centrally	Elastomeric insulation minimum class B- s3,d0 or PE Foam insulation	E 120 U/C, E 120 C/U, E 120 C/C, EI 45 U/C, EI 45 C/U, EI 45 C/C

# A.4.2 SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in 2x SikaSeal-626 Fire Board+ 2-S seals, in rigid walls

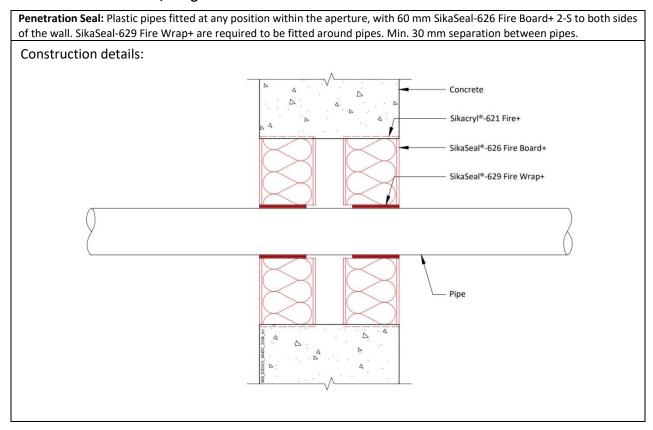


#### A.4.2.1

Services	Wrap	Classification
PVC-U pipe according to EN 1329-1, EN 1452-1 and EN 1	L453-1 and PVC-C accord	ling to EN 1566-1
Up to 40 mm diameter / 1.9-3.0 mm wall	50 x 1.8 mm	
Up to 110 mm diameter / 2.7-6.6 mm wall	50 x 3.6 mm	EI 240 U/C
Up to 125 mm diameter / 4.7-7.4 mm wall	50 x 7.2 mm	E1 240 0/C
Up to 160 mm diameter / 4.0-9.5 mm wall*	50 x 10.8 mm	
Up to 315 mm diameter/7.7-12.1 mm wall thickness*#	75 x 18 mm	EI 120 C/C
Up to 400 mm diameter/9.8-15.3 mm wall thickness*#	75 x 28.8 mm	EI 120 C/C
PE pipe according to EN 1519-1, EN 12201-2 and EN 126	666-1, ABS according to	EN 1455-1 and pipes made
from SAN+PVC according to EN 1565-1		
Up to 40 mm diameter / 2.4-4.6 mm wall	50 x 1.8 mm	
Up to 110 mm diameter / 3.4-10.0 mm wall	50 x 3.6 mm	F1 240 11/C
Up to 125 mm diameter / 3.9-7.4 mm wall	50 x 7.2 mm	EI 240 U/C
Up to 160 mm diameter / 4.9-9.5 mm wall	50 x 10.8 mm	
PP pipe according to EN 1451-1		
Up to 40 mm diameter / 1.8-5.5 mm wall	50 x 1.8 mm	EI 240 U/C
Up to 110 mm diameter / 2.7-10.0 mm wall	50 x 3.6 mm	
Up to 125 mm diameter / 3.1-11.4 mm wall	50 x 7.2 mm	EI 240 C/C
Up to 160 mm diameter / 4.9-14.6 mm wall	50 x 10.8 mm	

<sup>\*</sup> Typical pipe diameters shown, see below graph for intermediate sizes.


<sup>#</sup> Configuration 1 & 2

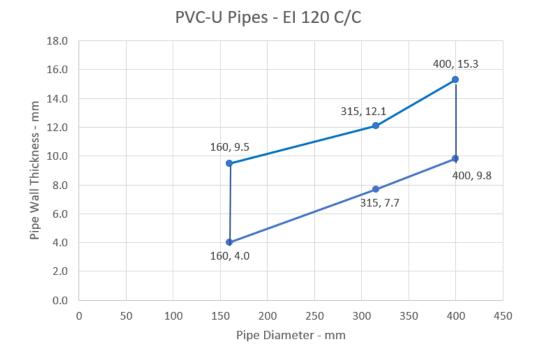

#### A.5 Rigid floor constructions with floor thickness of minimum 150 mm

### A.5.1 SikaSeal-629 Fire Wrap+ penetration seal for plastic pipes, in 1x SikaSeal-626 Fire Board+ 2-S, in rigid floors

**Penetration Seal:** Combustible pipes fitted at any position within the aperture, with 50 mm SikaSeal-626 Fire Board+ 2-S at mid-depth of the floor. SikaSeal-629 Fire Wrap+ are required to be fitted around combustible pipe insulation. Maximum aperture size 2400 mm x 1200 mm

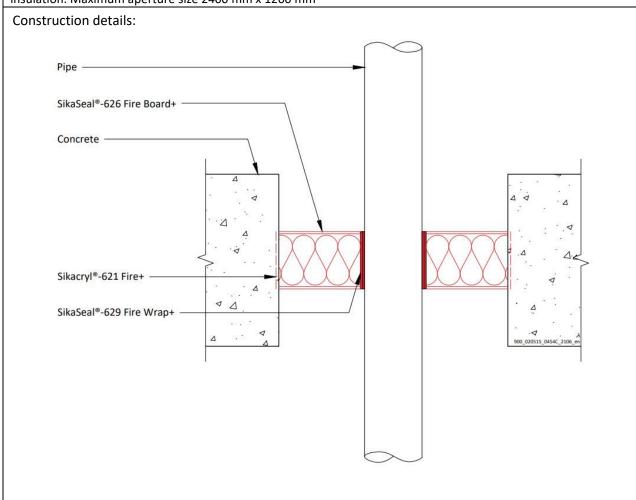


#### A.5.1.1

Services	Wrap	Classification
PVC-U pipe according to EN 1329-1, EN 1452-1 and EN 1453-1* 110 mm diameter/ 3.4mm wall	50 x 3.6 mm SikaSeal-629 Fire Wrap+	EI 90 U/C, EI 90 C/C

# A.5.2 SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in 1x SikaSeal-626 Fire Board+ 2-S, in rigid floors

**Penetration Seal:** CS (Continuous Sustained) insulated metallic pipes fitted at any position within the aperture, with 60 mm SikaSeal-626 Fire Board+ 2-S to either side of the floor (or anywhere in between). SikaSeal-629 Fire Wrap+ are required to be fitted around combustible pipe insulation. Maximum aperture size 2400 mm x 1200 mm

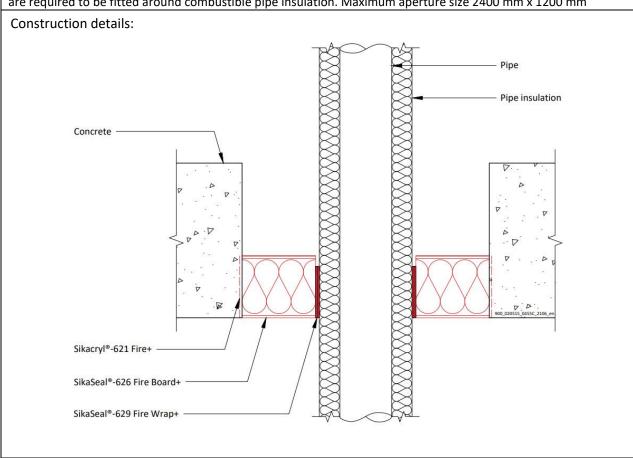


#### A.5.2.1

Services	Wrap	Insulation	Classification
Mild or stainless steel pipe			
165 mm diameter/ 4.5-14.2 mm	50 x 3.6 mm SikaSeal-	13 mm Elastomeric insulation minimum class B- s3,d0 or foil faced Phenolic Foam insulation	E 90 C/U, EI 45 C/U
wall	629 Fire Wrap+ fitted at bottom of seal	19 mm Elastomeric insulation minimum class B- s3,d0 or foil faced Phenolic Foam insulation	EI 90 C/U

# A.5.3 SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes in 2x SikaSeal-626 Fire Board+ 2-S (separated), in rigid floors

**Penetration Seal:** CS (Continuous Sustained) insulated metallic pipes fitted at any position within the aperture, with 60 mm SikaSeal-626 Fire Board+ 2-S to both sided of the floor. SikaSeal-629 Fire Wrap+ are required to be fitted around combustible pipe insulation at the soffit. Maximum aperture size 2400 mm x 1200 mm

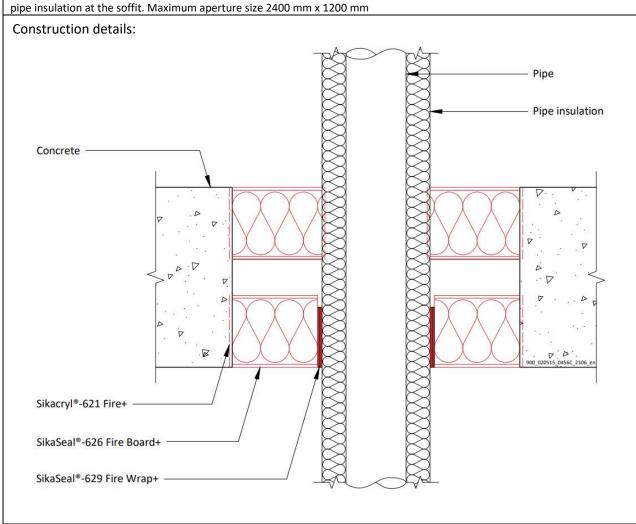


#### A.5.3.1 Double side penetration seal with pipes

Services	Wrap	Insulation	Classification
Mild or stainless steel pipe			
40 mm diameter/ 1-14.2 mm wall	50 x 1.8 mm SikaSeal- 629 Fire Wrap+	13 mm Elastomeric insulation minimum class B- s3,d0 or foil faced Phenolic Foam insulation	E 180 C/U, EI 120 C/U

# A.5.4 SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in 2x SikaSeal-626 Fire Board+ 2-S (back to back), in rigid floors

**Penetration Seal:** CS (Continuous Sustained) insulated metallic and composite pipes fitted at any position within the aperture, with two layers of 60 mm SikaSeal-626 Fire Board+ 1-S installed together to either side of the floor (or anywhere in between). SikaSeal-629 Fire Wrap+ are required to be fitted around combustible pipe insulation at the bottom of the seal. Maximum aperture size 2400 mm x 1200 mm

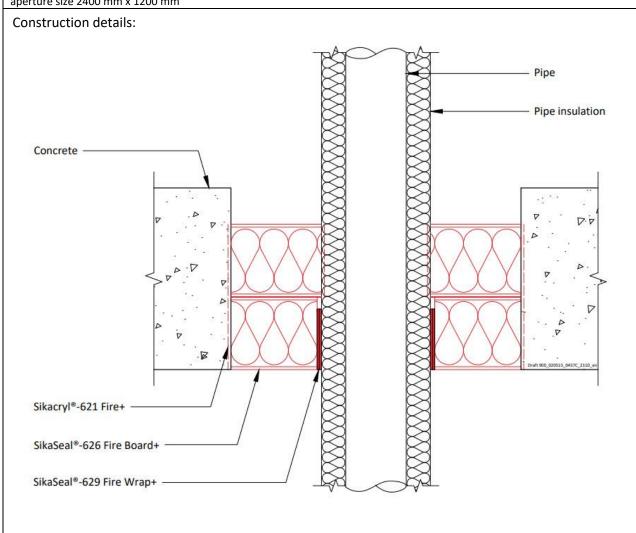


#### A.5.4.1

Services	Wrap	Insulation	Classification
Copper pipe			
12-54 mm diameter/1-1.2 mm wall	50 x 3.6 mm SikaSeal- 629 Fire Wrap+ fitted	9-13 mm Elastomeric insulation minimum class B-s3,d0 or foil faced Phenolic Foam insulation	E240 C/C, EI 60 C/C
12-54 mm diameter/1-1.2 mm wall	to both sides of the seal	13-25 mm Elastomeric insulation minimum class B-s3,d0 or foil faced Phenolic Foam insulation	E 180 C/C, EI 45 C/C
Geberit Mepla MLC (PE-Xb/Aluminium	/PE-HD pipe)	T	
16 mm diameter/2.25 mm wall 20 mm diameter/2.5 mm wall 26 mm diameter/3 mm wall 32 mm diameter/3 mm wall 40 mm diameter/3.5 mm wall 50 mm diameter/4 mm wall 63 mm diameter/4.5 mm wall 75 mm diameter/4.7 mm wall	50 x 3.6 mm SikaSeal- 629 Fire Wrap+ fitted	9 mm Elastomeric insulation minimum class B-s3,d0 or foil faced Phenolic Foam insulation	EI 120 C/C
16 mm diameter/2.25 mm wall 20 mm diameter/2.5 mm wall 26 mm diameter/3 mm wall 32 mm diameter/3 mm wall 40 mm diameter/3.5 mm wall 50 mm diameter/4 mm wall 63 mm diameter/4.5 mm wall 75 mm diameter/4.7 mm wall	to both sides of the seal	13-25 mm Elastomeric insulation minimum class B-s3,d0 or foil faced Phenolic Foam insulation	E 60 C/C, EI 45 C/C

#### A.6 Flexible wall constructions according to 2. 1)


### A.6.1 SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in 2x SikaSeal-626 Fire Board+ 1-S in flexible or rigid walls


**Penetration Seal:** CS (Continuous Sustained) insulated metallic pipes fitted at any position within the aperture, with 50 mm SikaSeal-626 Fire Board+ 1-S to both sides of the wall. Minimum separation between penetration seals and seal edges of 30 mm. SikaSeal-629 Fire Wrap+ are required to be fitted around the pipe insulation.

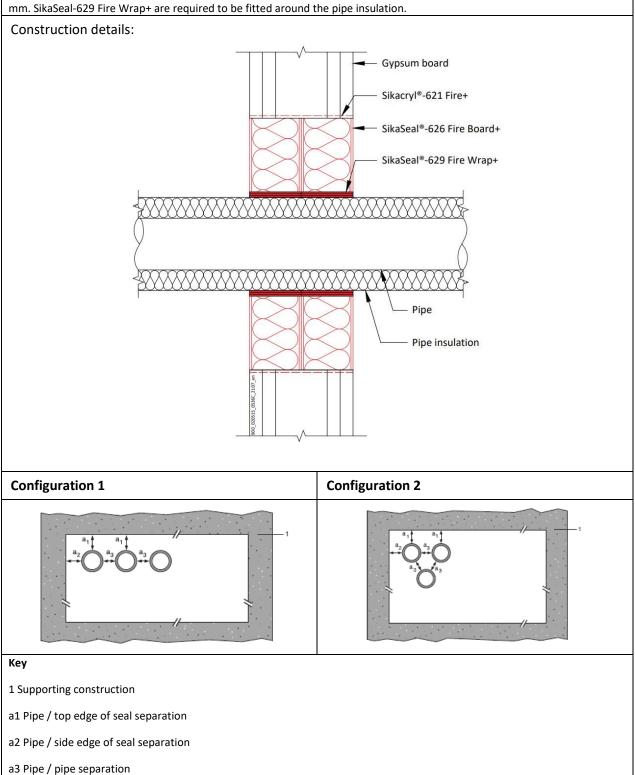

#### A.6.1.1


Mild or stainless steel pipe	Insulation	SikaSeal-629 Fire Wrap+	Classification
40 mm diameter/1-14.2 mm wall*			
50 mm diameter/1.2-14.2 mm wall*			
60 mm diameter/1.4-14.2 mm wall*			
75 mm diameter/1.6-14.2 mm wall*			
90 mm diameter/1.9-14.2 mm wall*			
100 mm diameter/2.1-14.2 mm wall*			
115 mm diameter/2.4-14.2 mm wall*	32-50 mm thick Elastomeric insulation minimum class B-	3 layers 50 x 1.8 mm	
140 mm diameter/2.9-14.2 mm wall*			EI 90 C/U
165 mm diameter/ 3.4-14.2 mm wall*	s3,d0 or PE Foam insulation	1.6 mm	
180 mm diameter/ 3.6-14.2 mm wall*			
200 mm diameter/ 4.0-14.2 mm wall*			
219 mm diameter/ 4.3-14.2 mm wall*			
250 mm diameter/ 5.0-14.2 mm wall*			
300 mm diameter/ 5.9-14.2 mm wall*			
324 mm diameter/ 6.35-14.2 mm wall*			



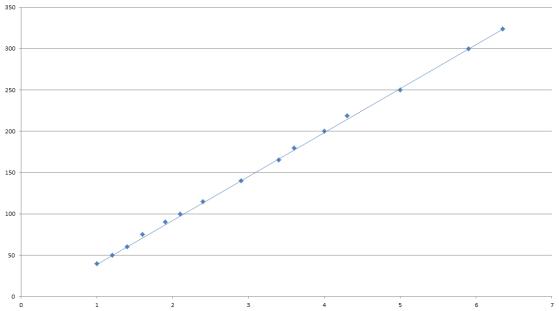

# A.6.2 SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in 2x SikaSeal-626 Fire Board+ 1-S, in flexible or rigid walls

**Penetration Seal:** CS (Continuous Sustained) insulated metallic pipes fitted at any position within the aperture, with 50 mm SikaSeal-626 Fire Board+ 1-S to both sides of the wall. SikaSeal-629 Fire Wrap+ are required to be fitted around the pipe insulation.

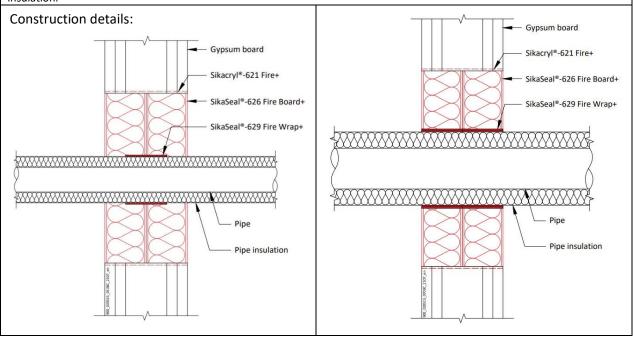


#### A.6.2.1

Services	Wrap	Insulation	Classification
Mild or stainless steel pipe			
40 mm diameter/1-14.2 mm wall	50 x 1.8 mm SikaSeal- 629 Fire Wrap+ fitted centrally	13 mm Elastomeric insulation minimum class B-s3,d0 or PE Foam insulation	EI 120 U/C, EI 120 U/U, EI 120 C/U, EI 120 C/C
40 mm diameter/1-14.2 mm wall* 50 mm diameter/1.3-14.2 mm wall* 60 mm diameter/1.6-14.2 mm wall* 75 mm diameter/2-14.2 mm wall* 90 mm diameter/2.4-14.2 mm wall* 100 mm diameter/2.7-14.2 mm wall*	2 off 50 x 3.6 mm SikaSeal-629 Fire Wrap+, one fitted flush to each face of seal	13 - 32mm Elastomeric insulation minimum class B-s3,d0 or PE	E 120 U/C, E 120 U/U, E 120 C/U, E 120 C/C, EI 60 U/C, EI 60 U/U, EI 60 C/U, EI 60 C/C
115 mm diameter/3.1-14.2 mm wall*  140 mm diameter/3.8-14.2 mm wall*  165 mm diameter/ 4.5-14.2 mm wall*		Foam insulation	


<sup>\*</sup> Typical pipe diameters shown, see below graph for intermediate sizes

#### Pipe diameter vs Wall thickness

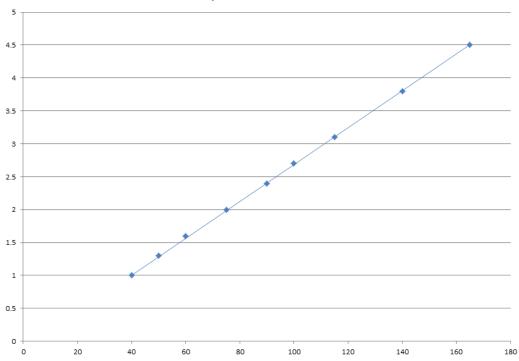

# A.6.3 SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in 2x SikaSeal-626 Fire Board+ 1-S, in flexible or rigid walls

**Penetration Seal:** LS (Local Sustained) or CS (Continuous Sustained) insulated metallic and composite pipes (single) fitted at any position within the aperture, with 50 mm SikaSeal-626 Fire Board+ 1-S to both sides of the wall. SikaSeal-629 Fire Wrap+ are required to be fitted around the pipe to both sides of the seal.

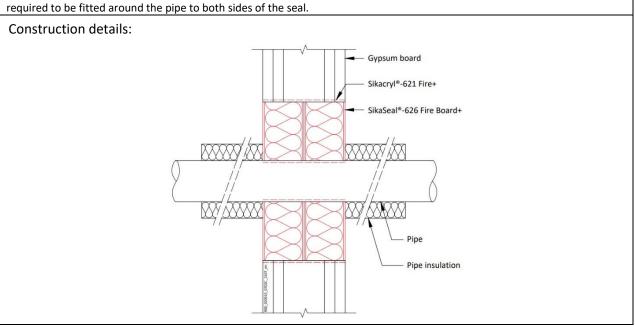

#### A.6.3.1

Services	Wrap	Insulation	Classification
Copper pipe			
12 mm diameter/1 mm wall		9 mm Elastomeric insulation minimum class B-s3,d0 or PE Foam insulation	EI 120 C/C
12-54 mm diameter/1-1.2 mm wall	50 x 3.6 mm SikaSeal- 629 Fire Wrap+ fitted to both sides of the	9-13 mm Elastomeric insulation minimum class B-s3,d0 or PE Foam insulation	E 120 C/C, EI 90 C/C
12-54 mm diameter/1-1.2 mm wall	seal	13-25 mm Elastomeric insulation minimum class B-s3,d0 or PE Foam insulation	E 120 C/C, EI 60 C/C
Geberit Mepla MLC (PE-Xb/Aluminium	/PE-HD pipe)*		
16 mm diameter/2.25 mm wall			
20 mm diameter/2.5 mm wall			
26 mm diameter/3 mm wall			
32 mm diameter/3 mm wall	50 x 3.6 mm SikaSeal- 629 Fire Wrap+ fitted	9-25 mm Elastomeric insulation minimum	51 4 20 C/C
40 mm diameter/3.5 mm wall	to both sides of the	class B-s3,d0 or PE	EI 120 C/C
50 mm diameter/4 mm wall	seal	Foam insulation	
63 mm diameter/4.5 mm wall			
75 mm diameter/4.7 mm wall			

# A.6.4 SikaSeal-629 Fire Wrap+ penetration seal for insulated metal pipes, in 2x SikaSeal-626 Fire Board+ 1-S, in flexible or rigid walls

P Penetration Seal: Combustible pipes (single) fitted central within the aperture, with SikaSeal-626 Fire Board+ 1-5 to both sides of the wall. SikaSeal-629 Fire Wrap+ are required to be fitted around the pipe.

Construction details:

Gypsum board

SikaSeal®-626 Fire Board+

SikaSeal®-626 Fire Board+

SikaSeal®-629 Fire Wrap+

Pipe

Pipe


Pipe insulation

#### A.6.4.1

Services	Pipe Wrap	Classification
PVC-U pipe according to EN 1329-1, EN 1452-1 and EN 1453-1 315 mm Ø/9.2 mm wall	SikaSeal-629 Fire Wrap+ 75 x 18 mm fitted centrally around the pipe	EI 45 C/C

# A.6.5 SikaSeal-629 Fire Wrap+ penetration seal for plastic pipes, in 2x SikaSeal-626 Fire Board+ 1-S, in flexible or rigid walls

**Penetration Seal:** Combustible pipes sealed with SikaSeal-629 Fire Wrap+, to both sides of the wall. Minimum separation between penetration seals and seal edges of 30 mm. (Configuration 1 & 2).

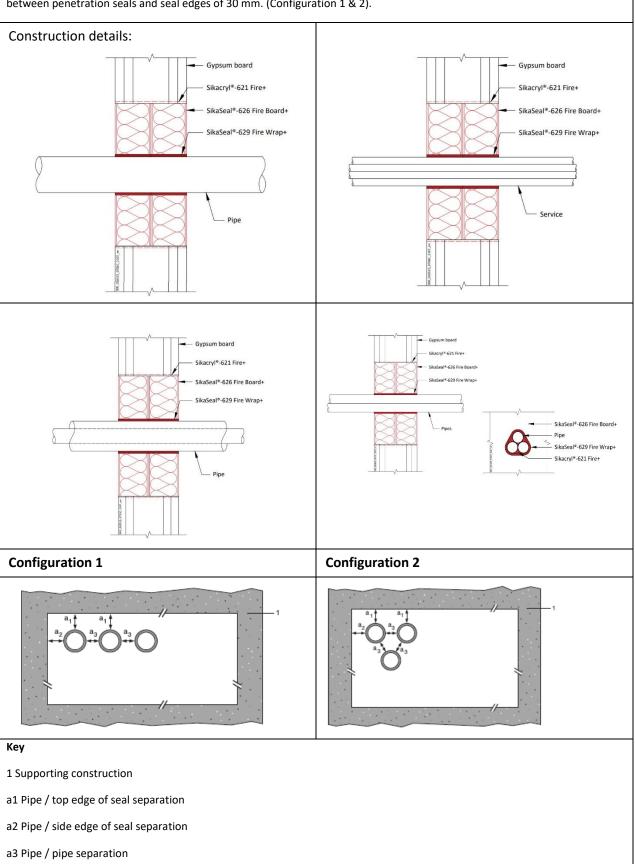

#### A.6.5.1


Services	Wraps	Permitted	Classification
PVC-U pipe according to EN 1329-1, EN	(both sides)	configuration for	
1452-2 and EN 1453-1 and PVC-C	,	seal separation	
according to EN 1566-1			
Diameter up to 40 mm, wall thickness 1.9	50 x 1.8 mm (1		EI 120 U/U, EI 120 C/U,
- 3.0 mm	layer)		EI 120 U/C, EI 120 C/C
Diameter up to 110 mm, wall thickness	50 x 3.6 mm (2 x	1 & 2 between PVC-	,
2.7 - 6.6 mm	1.8 layer)	U/PVC-C,	
Diameter up to 125 mm, wall thickness	50 x 5.4 mm (3 x	PE/ABS/SAN+PVC	E 120 U/C, E 120 C/C
3.7 – 7.4 mm	1.8 layer)	and PP pipes in any	EI 90 U/C, EI 90 C/C
Diameter up to 160 mm, wall thickness	50 x 7.2 mm (4 x	combination	
9.5 mm *	1.8 layer)		
Diameter up to 315 mm, wall thickness	50 x 18 mm (10 x	n/a	
7.7-12.1 mm*	1.8 layers)	11, 4	EI 90 C/C
Diameter up to 400 mm, wall thickness	50 x 28.8 mm	n/a	
9.8-15.3 mm*	(16 x 1.8 layers)	11/4	EI 90 C/C
Diameter up to 110 mm, wall thickness	(10 x 1.0 layers)		
2.7–6.6 mm, fully or partially filled	50 x 3.6 mm (2 x	1 & 2	
conduits with cables up to 14 mm	1.8 layers)	1 0 2	E 120 U/C, EI 90 U/C
diameter	1.0 layers)		
PE pipe according to EN 1519-1, EN 12201-	2 and FN 12006-1 A	RS according to FN 145	L 5-1 and nines made
from SAN+PVC according to EN 1565-1	2 and LN 12000-1, A	according to LIV 143	13-1 and pipes made
Diameter up to 40 mm, wall thickness 2.4	50 x 1.8 mm (1		EI 120 U/U, EI 120 C/U,
- 3.7 mm	layer)		EI 120 U/C, EI 120 C/C
Diameter up to 110 mm, wall thickness	50 x 3.6 mm (2 x	1 & 2 between PVC-	Li 120 0/C, Li 120 C/C
4.2 - 10 mm	1.8 layer)	U/PVC-C,	
Diameter up to 125 mm, wall thickness	50 x 5.4 mm (3 x	PE/ABS/SAN+PVC	E 120 U/C, E 120 C/C
4.8 – 12 mm	1.8 layer)	and PP pipes in any	EI 90 U/C, EI 90 C/C
Diameter up to 160 mm, wall thickness	50 x 7.2 mm (4 x	combination	21 30 0/ 0, 21 30 0/ 0
14.6 mm	1.8 layer)		
Diameter up to 110 mm, wall thickness	1.0 layery		
4.2–10 mm, fully or partially filled	50 x 3.6 mm (2 x	1 & 2	
conduits with cables up to 14 mm	1.8 layers)	102	E 120 U/C, EI 90 U/C
diameter	1.0 layers)		
PP pipe according to EN 1852-1: 2009			
Diameter up to 40 mm, wall thickness 1.8	50 x 1.8 mm (1		EI 120 U/U, EI 120 C/U,
- 5.5 mm	layer)		EI 120 U/C, EI 120 C/C
Diameter up to 110 mm, wall thickness	50 x 3.6 mm (2 x	1 & 2 between PVC-	EI 90 U/U, EI 90 C/U,
2.7 - 15.1 mm	1.8 layer)	U/PVC-C,	EI 90 U/C, EI 90 C/C
		PE/ABS/SAN+PVC	E1 30 0/C, E1 30 C/C
Diameter up to 125 mm, wall thickness 3.1 – 17.1 mm	50 x 5.4 mm (3 x	and PP pipes in any	E 400 11/0 E 400 0/5
	1.8 layer)	combination	E 120 U/C, E 120 C/C
Diameter up to 160 mm, wall thickness	50 x 7.2 mm (4 x		EI 90 U/C, EI 90 C/C
21.9 mm	1.8 layer)		
Diameter up to 110 mm, wall thickness			
2.7–15.1 mm, fully or partially filled	50 x 3.6 mm (2 x	1 & 2	E 120 U/C, EI 90 U/C
conduits with cables up to 14 mm	1.8 layers)		2 22 3 7 5 2 5 6 7 6
diameter			
Uponor Wirsbo PEX pipe in pipe system according to ISO 15875			
Diameter up to 54 mm/4.0 mm wall		1 & 2	EI 120 C/C
thickness (outer pipe), 28 mm	50 x 3.6 mm (2 x		
diameter/0.4 mm wall thickness (inner	1.8 layers)		
pipe)			

Page 62 of 68 of European Technical Assessment ETA-21/1032 issued on 2021-11-25


Uponor Wirsbo PEX double pipe in pipe sys	tem		
Diameter up to 25 mm pipes, wall	50 x 3.6 mm (2 x	1 & 2	EI 90 C/C
	, ,	1 & 2	E1 90 C/C
thickness 0.6 mm, in bundles up to 50 mm	1.8 layers)		
BluePower Multilayer pipe according to EN	1451-1		
32-50 mm diameter/1.8 mm wall	50 x 3.6 mm (2 x	1 & 2	EI 90 U/U
thickness*	1.8 layers)	1 4 2	2.300,0
75-110 mm diameter/3.4 mm wall	50 x 3.6 mm (2 x	1 & 2	EI 90 C/U
thickness*	1.8 layers)	1 & 2	L1 30 C/ 0
Rehau Raupiano Plus PP-DD according to D			
40-50 mm diameter/1.8-2.7 mm wall	50 x 3.6 mm (2 x	1 & 2	EI 120 U/U
•	, ,	1 & 2	EI 120 0/0
thickness*	1.8 layers)	4.0.2	EL 420 LL/C
75-110 mm diameter/2.7 mm wall	50 x 3.6 mm (2 x	1 & 2	EI 120 U/C
thickness*	1.8 layers)		
125 mm diameter/3.9 mm wall thickness	50 x 7.2 mm (4 x	1 & 2	EI 120 U/C
	1.8 layers)		
160 mm diameter/3.9 mm wall thickness	50 x 10.8 mm (6	1 & 2	EI 120 U/C
	x 1.8 layers)		
Polo-Kal NG Poloplast PP-MV according to			
32-50 mm diameter/2.0-3.4 mm wall	50 x 3.6 mm (2 x	1 & 2	EI 120 U/U
thickness*	1.8 layers)		
75-110 mm diameter/3.4 mm wall	50 x 3.6 mm (2 x	1 & 2	EI 120 U/C
thickness*	1.8 layers)		
125 mm diameter/3.9 mm wall thickness	50 x 7.2 mm (4 x	1 & 2	EI 120 U/C
	1.8 layers)		
160 mm diameter/4.9 mm wall thickness	50 x 10.8 mm (6	1 & 2	EI 120 U/C
	x 1.8 layers)		
Aquatherm Green SDR9 MF PP-RP accordir	ng to ISO 21003		
22 1: 1/2 0 11:1:1	50 40 /4	4.0.2	5 420 6/6 5L00 6/6
32 mm diameter/3.0 mm wall thickness	50 x 1.8 mm (1 x	1 & 2	E 120 C/C, EI 90 C/C
	1.8 layer)		
40-50 mm diameter/5.6-12.3 mm wall	50 x 3.6 mm (2 x	1 & 2	E 120 C/C, EI 90 C/C
thickness*	1.8 layers)		
63-110 mm diameter/12.3 mm wall	50 x 3.6 mm (2 x	1 & 2	E 120 C/C, EI 90 C/C
thickness*	1.8 layers)		
Wavin SiTech + PP-M B according to EN 13			
32-50 mm diameter/1.8-3.4 mm wall	50 x 3.6 mm (2 x	1 & 2	E 120 U/U, EI 90 U/U
thickness*	1.8 layers)		
75-110 mm diameter/3.4 mm wall	50 x 3.6 mm (2 x	1 & 2	E 120 U/C, EI 60 U/C
thickness*	1.8 layers)		
Gilbert Silent PP according to DIN 4102			
32-50 mm diameter/1.8-3.4 mm wall	50 x 3.6 mm (2 x	1 & 2	EI 120 U/U
thickness*	1.8 layers)		
75-110 mm diameter/3.4 mm wall	50 x 3.6 mm (2 x	1 & 2	EI 120 U/C
thickness*	1.8 layers)		

<sup>\*</sup>See below graph for interpolation pipe sizes


### PVC-U Pipes - E 90 C/C, EI 60 C/C

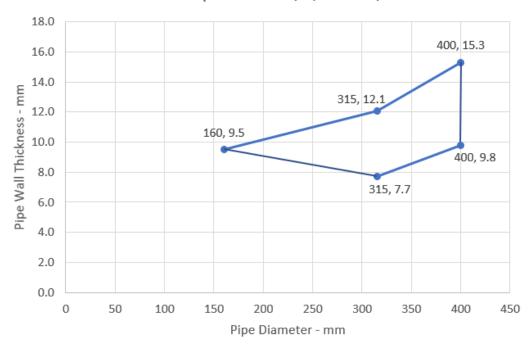


### BluePower - EI 90 C/U

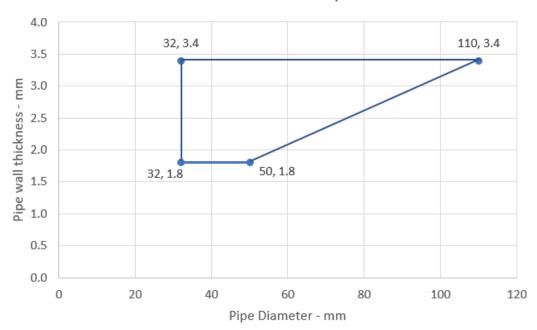


### Rehau Raupiano Plus -EI 120 U/C

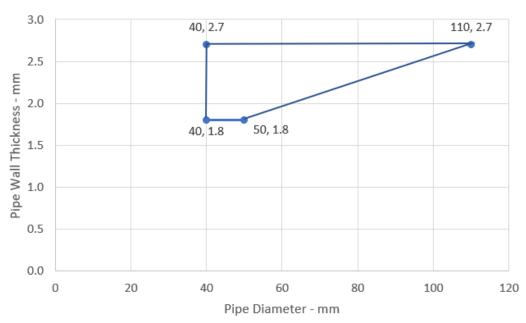


### Polo-Kal NG - EI 120 U/C

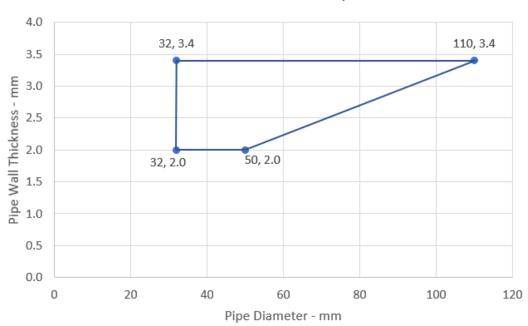


### Aquatherm Green - E 120 C/C, EI 90 C/C

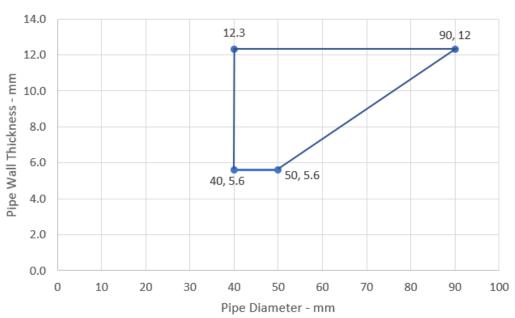

### Wavin SiTech Pipes - E120 C/C, EI 60 C/C

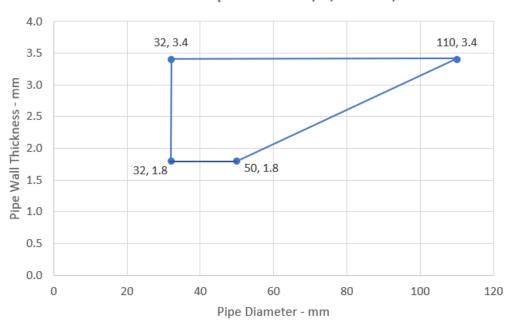

### Gilbert Silent PP - EI 120 U/C

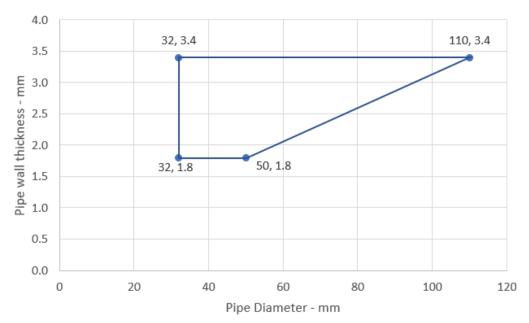

### A.6.6 Penetration seal in Sikacrete-630 Fire+ seals, in flexible\* and rigid walls minimum 100 mm thick

Penetration Seal: Combustible pipes sealed with SikaSeal-629 Fire Wrap+, installed into Sikacrete-630 Fire+ seals. Minimum separation between penetration seals and seal edges of 30 mm. Construction details: Gypsum board -Mineral fibre backing Sikacrete®-630 Fire+ SikaSeal®-629 Fire Wrap+ Pipe **Configuration 1 Configuration 2** 1 Supporting construction a1 Pipe / top edge of seal separation a2 Pipe / side edge of seal separation a3 Pipe / pipe separation

<sup>\*</sup> Partition wall must incorporate a full fill core insulation of Stonewool (35kg/m3 density)

#### A.6.6.1

Services	Wraps	Permitted configuration	Classification	
PVC-U pipe according to EN 1329-1, EN	(both sides)	for seal separation		
1452-2 and EN 1453-1 and PVC-C				
according to EN 1566-1				
Diameter up to 40 mm, wall thickness	50 x 1.8 mm		E 120 U/C, E 120 C/U,	
3.0 – 4.3 mm	(1 layer)		EI 60 U/C, EI 60 C/C	
Diameter up to 110 mm, wall thickness	50 x 3.6 mm	1 & 2 between PVC-	E 120 U/C, E 120 C/C	
2.7 - 6.6 mm	(2 x 1.8 layer)	U/PVC-C,	EI 90 U/C, EI 90 C/C	
Diameter up to 125 mm, wall thickness	50 x 5.4 mm	PE/ABS/SAN+PVC and PP	EI 120 U/C, EI 120 C/C	
3.7 – 7.4 mm	(3 x 1.8 layer)	pipes in any combination	El 120 0/C, El 120 C/C	
Diameter up to 160 mm, wall thickness	50 x 7.2 mm		EI 60 U/C, EI 60 C/C	
3.2 - 9.5 mm	(4 x 1.8 layer)		E1 60 0/C, E1 60 C/C	
PE pipe according to EN 1519-1, EN 12201-2 and EN 12006-1, ABS according to EN 1455-1 and pipes made from SAN+PVC according to EN 1565-1				
Diameter up to 40 mm, wall thickness	50 x 1.8 mm		EI 120 U/C, EI 120 C/C	
3.2 – 3.7 mm	(1 layer)		Li 120 0/ c, Li 120 c/ c	
Diameter up to 110 mm, wall thickness	50 x 3.6 mm		EI 60 U/C, EI 60 C/C	
4.2 - 10 mm	(2 x 1.8 layer)	1 & 2 between PVC-	21 00 0/C, 21 00 C/C	
Diameter up to 125 mm, wall thickness	50 x 5.4 mm	U/PVC-C,	EI 120 U/C, EI 120 C/C	
12 mm	(3 x 1.8 layer)	PE/ABS/SAN+PVC and PP	21 120 07 0, 21 120 07 0	
Diameter up to 160 mm, wall thickness		pipes in any combination	E 120 U/C, E 120 C/C	
4.9 – 12.0 mm	50 x 7.2 mm		2 220 0, 0, 2 220 0, 0	
Diameter up to 160 mm, wall thickness	(4 x 1.8 layer)		EI 90 U/C, EI 90 C/C	
12.0 mm			21 30 07 0, 21 30 07 0	
PP pipe according to EN 1852-1: 2009				
Diameter up to 40 mm, wall thickness	50 x 1.8 mm		EI 120 U/C, EI 120 C/C	
4.0 – 5.5 mm	(1 layer)		Li 120 0/C, Li 120 C/C	
Diameter up to 110 mm, wall thickness	50 x 3.6 mm		E 120 U/C, E 120 C/C	
6.6 mm	(2 x 1.8 layer)	1 & 2 between PVC-	EI 90 U/C, EI 90 C/C	
Diameter up to 125 mm, wall thickness	50 x 5.4 mm	U/PVC-C,	E 120 U/C, E 120 C/C	
17.1 mm	(3 x 1.8 layer)	PE/ABS/SAN+PVC and PP	EI 90 U/C, EI 90 C/C	
Diameter up to 160 mm, wall thickness	,	pipes in any combination		
4.0 - 21.9 mm	50 x 7.2 mm		E 120 U/C, E 120 C/C	
Diameter up to 160 mm, wall thickness 21.9 mm	(4 x 1.8 layer)		EI 60 U/C, EI 60 C/C	